

# HTS power transmission (and distribution): status and prospects

**Antonio Morandi**

DEI – Guglielmo Marconi

Dep. of Electrical, Electronic and Information Engineering

University of Bologna, Italy

*antonio.morandi@unibo.it*



***CCA (Coated Conductor for Applications) 2025 workshop***

---

***Tuesday, March 11, 2024, CERN - Geneve,  
Switzerland***

**CCA2025**

International Workshop on Coated Conductors for Applications


# Outline

## HTS power cables:

- **What they are**
  - **General characteristics**
  - **State of the art**
- **What they can do for you - power cable need today and tomorrow**
  - **How much**
  - **Which type**

**The role of HTS power cables**


# Layout of a conventional HV power cable

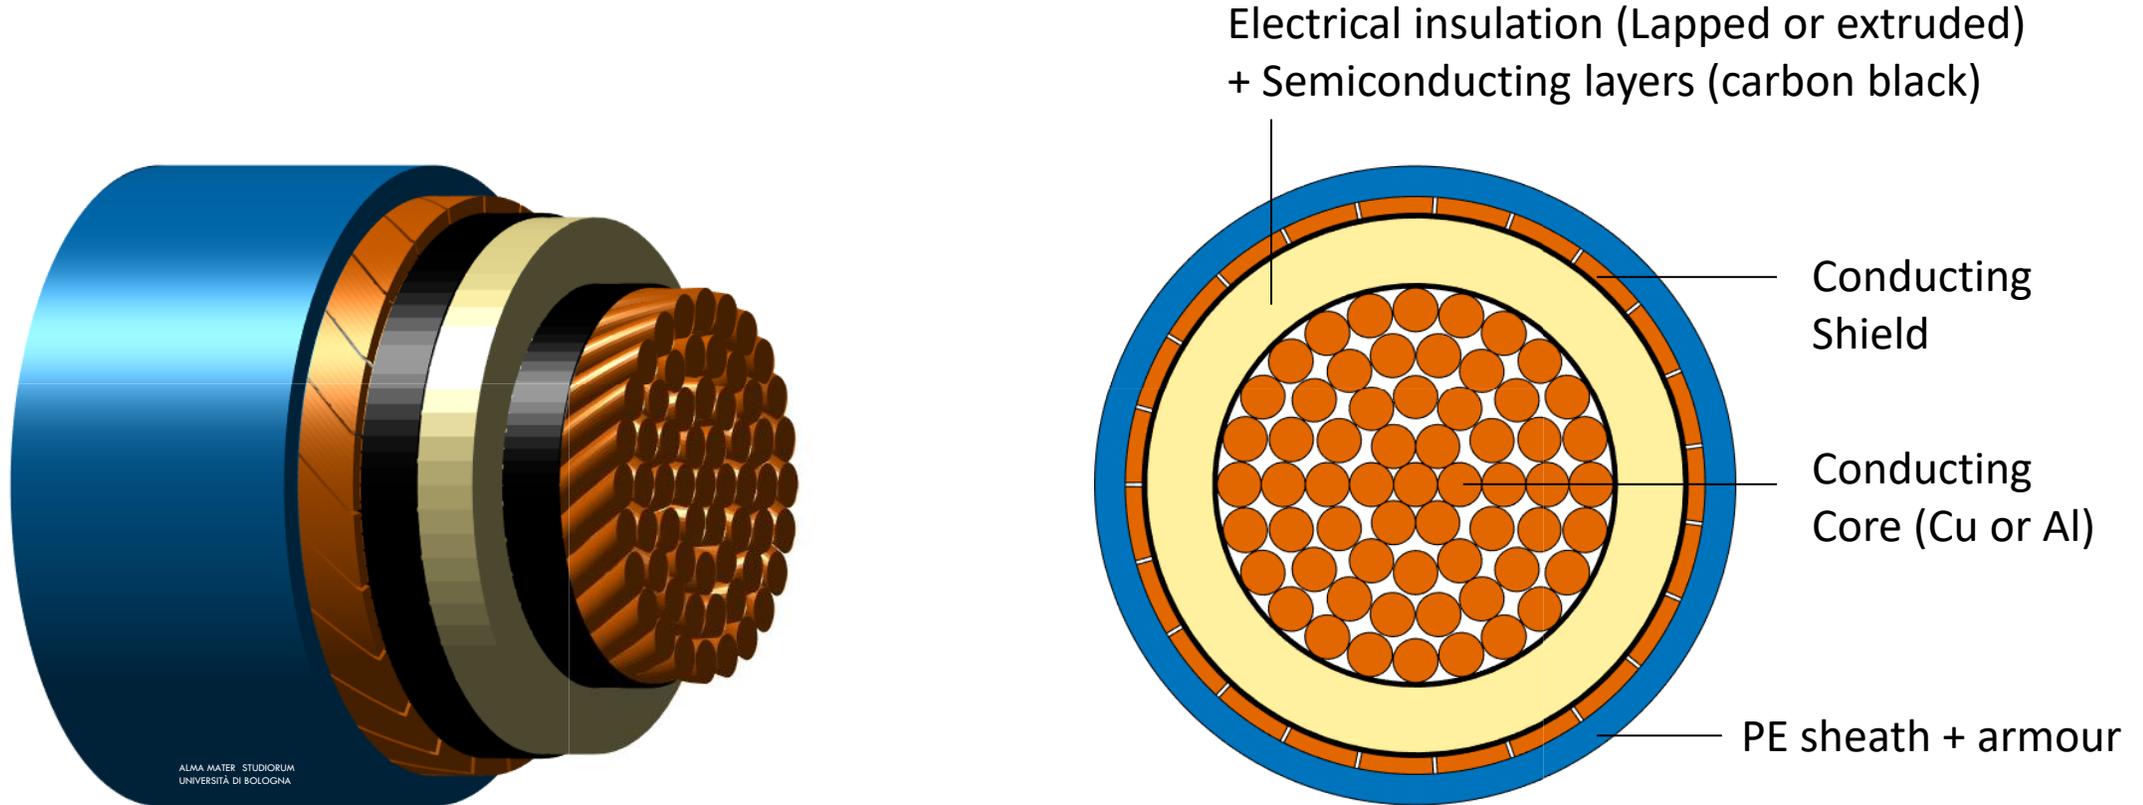

A metallic shield (copper) is added to HV voltage cables in order to

- Equalize electric field stress in the cable insulation
- Provide shielding of electromagnetic field + return path for cable neutral and fault current


# Layout of a cold dielectric superconducting power cable

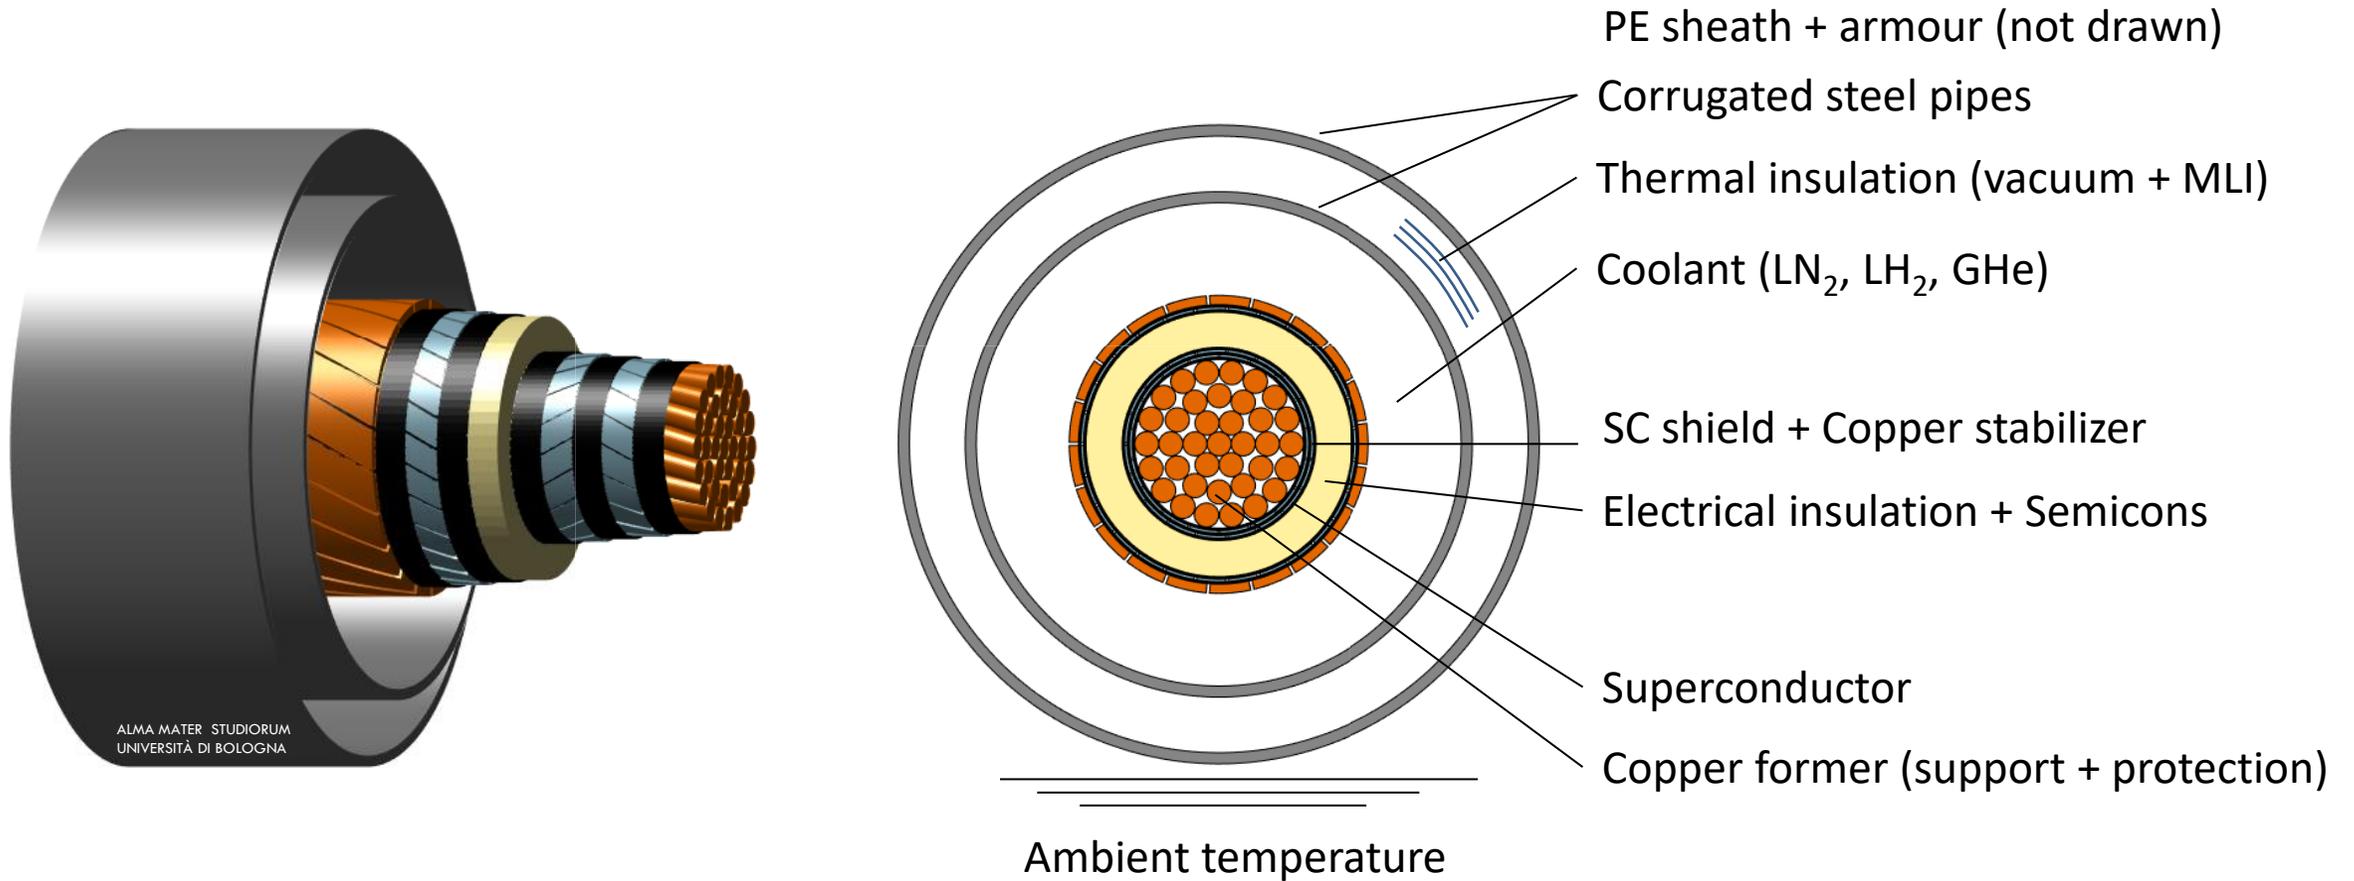

A shield is required to

- Equalize electric field stress in the cable insulation
- Shield EM field + provide return path for neutral and fault current
- **Prevent induced currents and loss in metallic pipes**


*A shield requiring as much SC as the core is needed in AC applications*

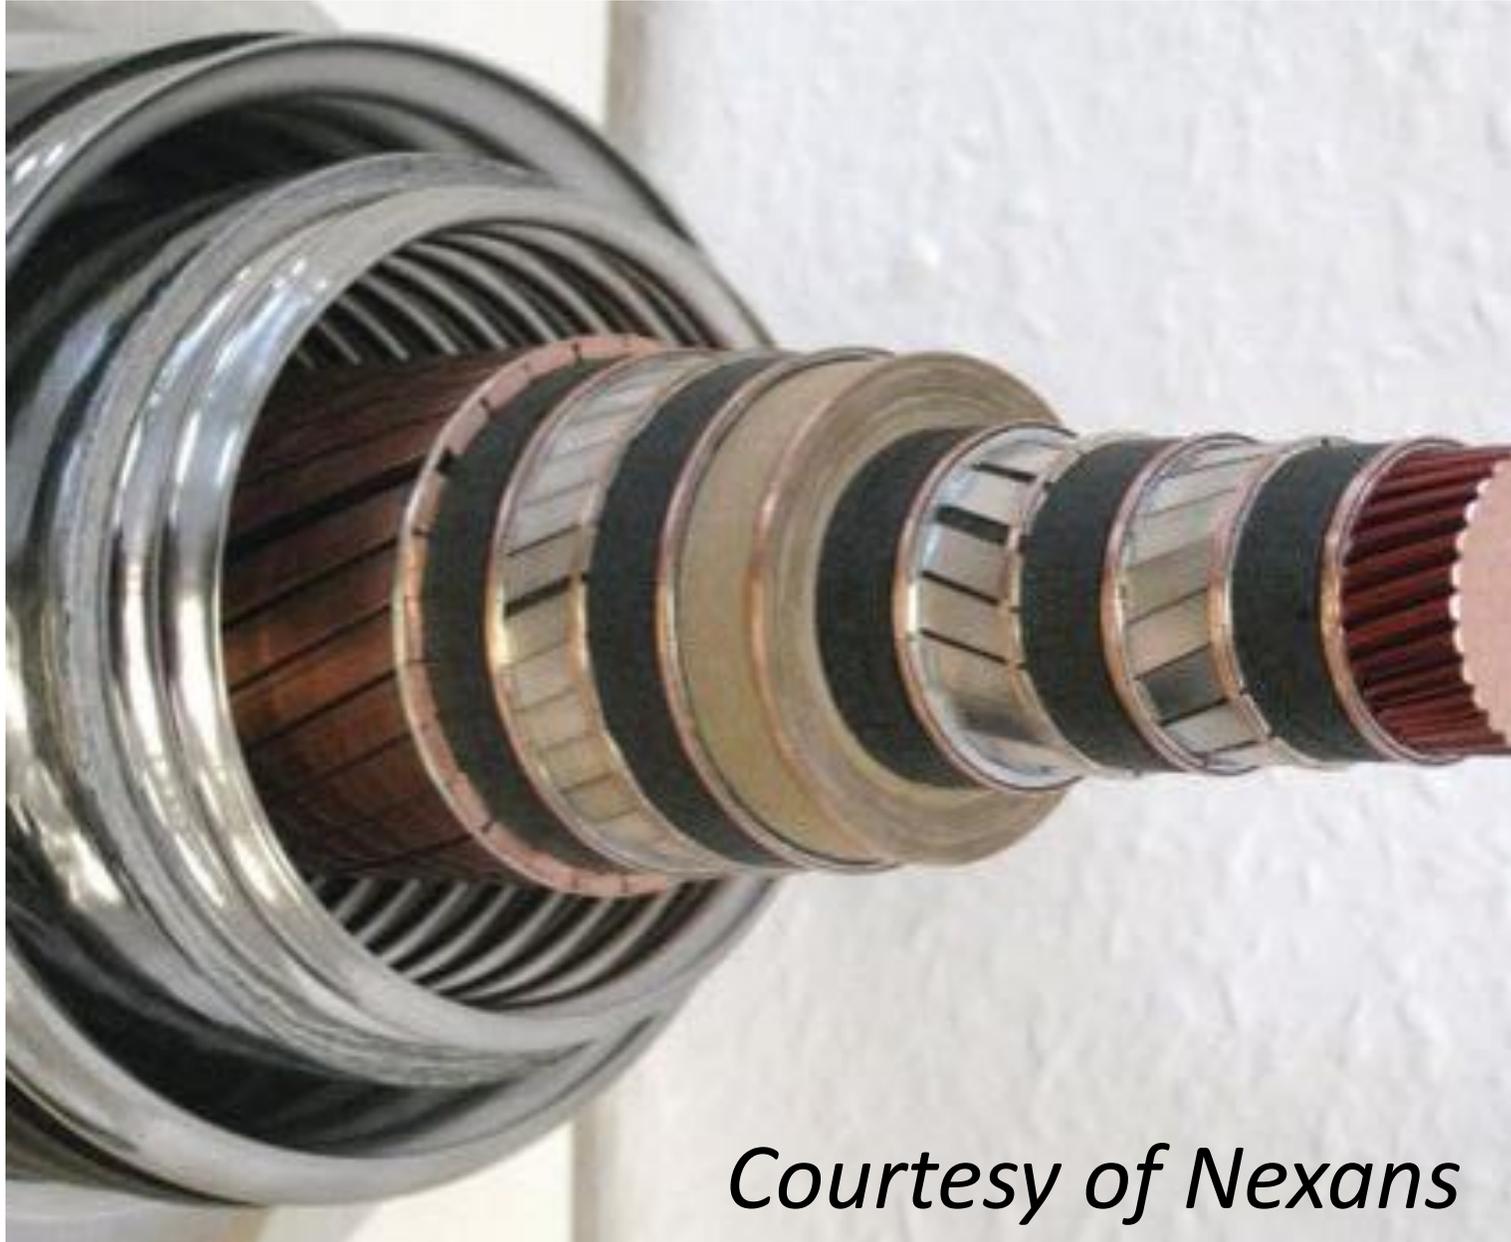

*Courtesy of Nexans*

# Shield design of DC superconductor cables

## DC cable system (pipes not drawn)

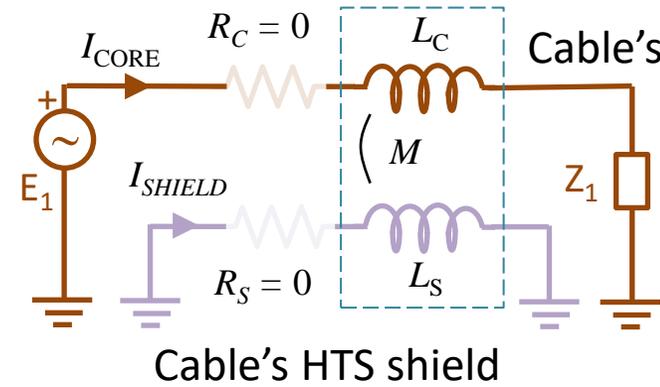


**Strongly coupled**

$$M \approx \sqrt{L_C L_S}$$


$$\text{and } L_C \approx L_S$$

$$I_{SHIELD} \approx I_{CORE}$$

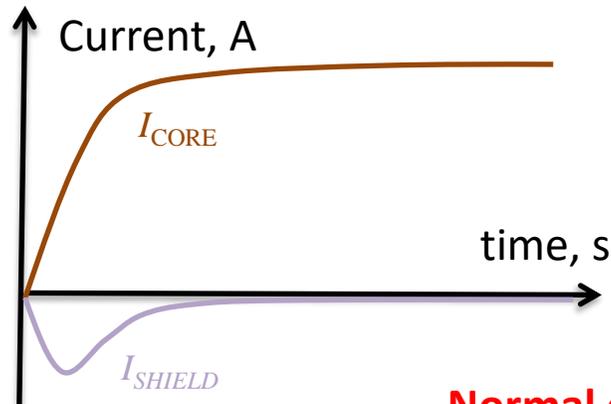



- Current is induced in the shield only during transients (energization and fault)
- No significant heating is added to the cable also in case of copper shield

**Normal conducting shield for DC superconducting cables is viable**

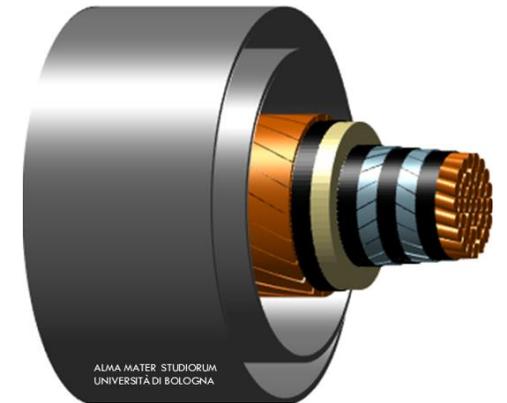

# Shield design of AC superconductor cables

## AC cable system (pipes not drawn)

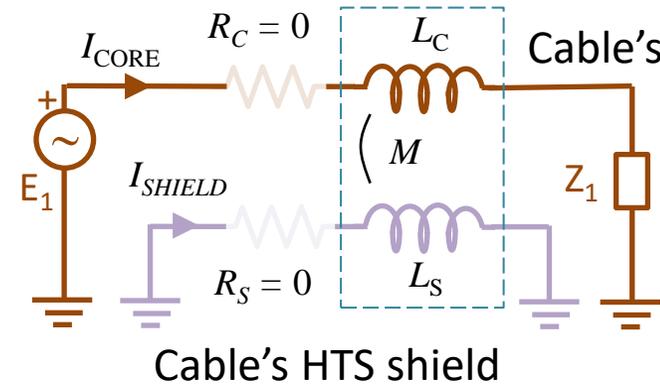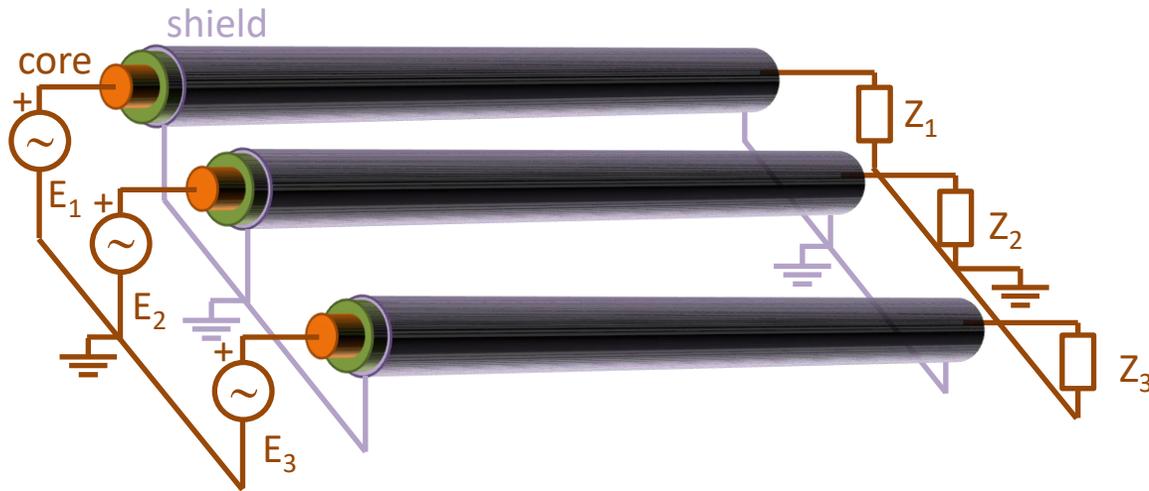


**Strongly coupled**


$$M \approx \sqrt{L_C L_S}$$

$$\text{and } L_C \approx L_S$$


$$I_{SHIELD} \approx I_{CORE}$$

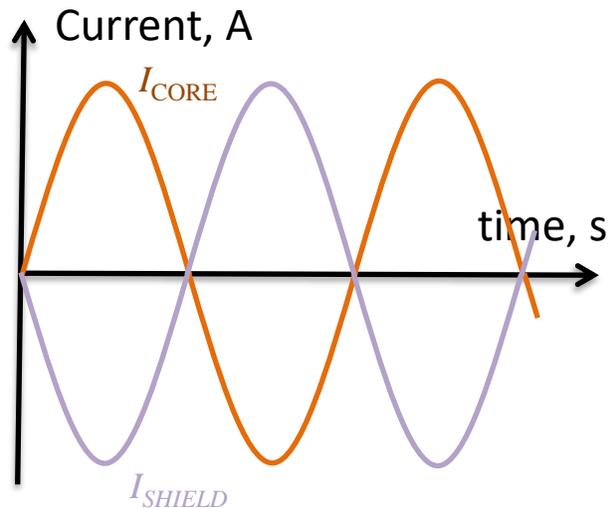


- Induced currents in inner metallic pipe and additional heat load are prevented with the HTS shield
- Practically the same AC current (with 180° phase shift) of the core circulates in the shielding steady AC regime. **The same amount of SC as for the core is needed for the shield**

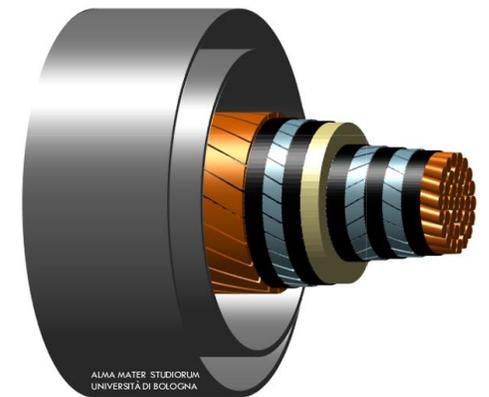


# Essential “accessories” of HTS (and conventional) power cables: terminations and joints

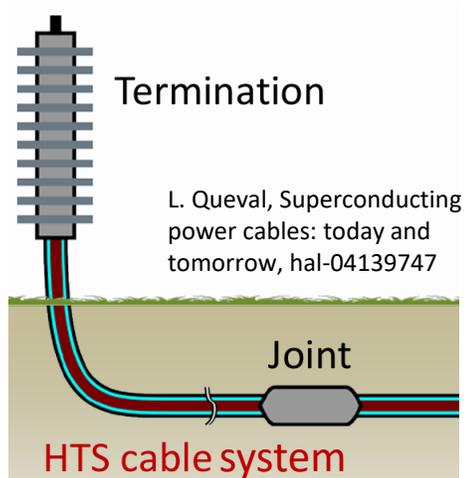

## Schematic of the termination

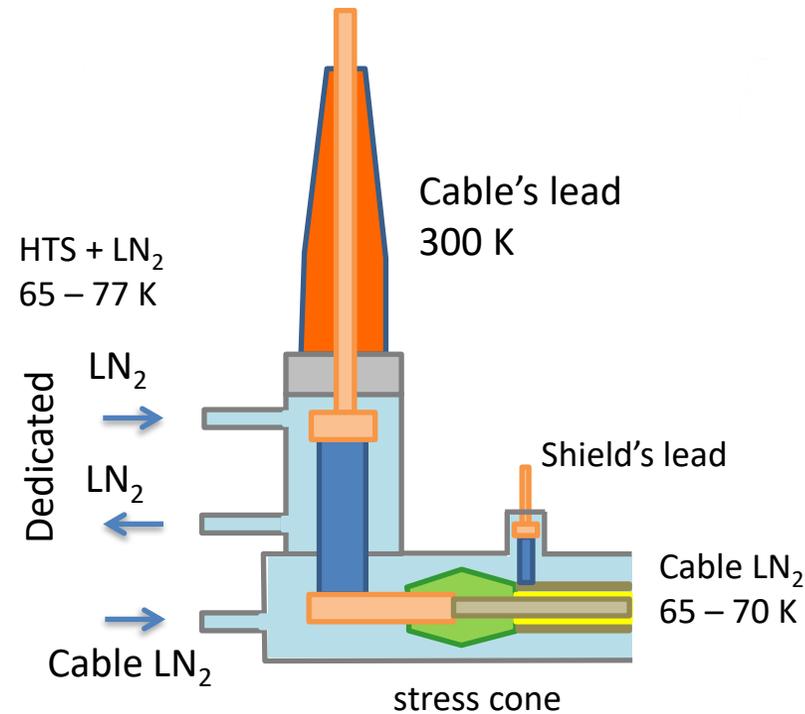

## Schematic of the joint

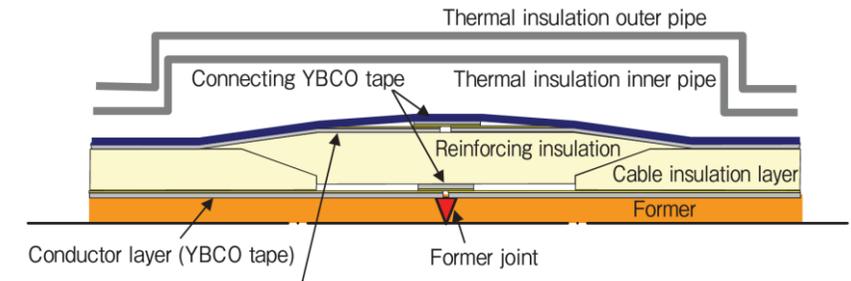

S. Mukoyama et al., Development of YBCO High-Tc Superconducting Power Cables, Furukawa Review, No. 35 2009



## Termination of the LIPA1 HTS cable

*Courtesy of Nexans*





- Connection to the grid
- Management of electric stress
- Management of thermal gradient
- Management of mechanical contraction during cool down


# AC three phase (or DC bipolar) arrangements

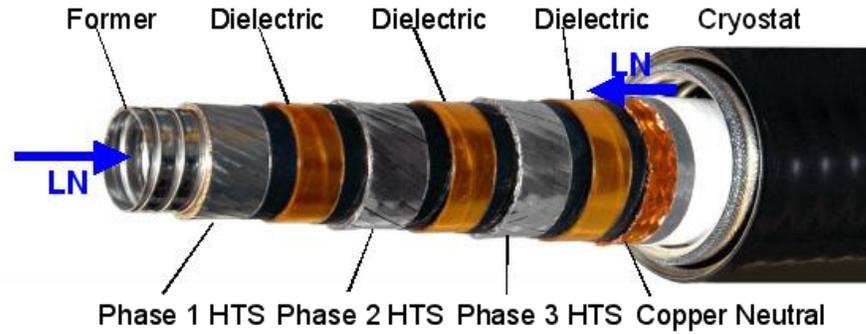

**Concentric phases**

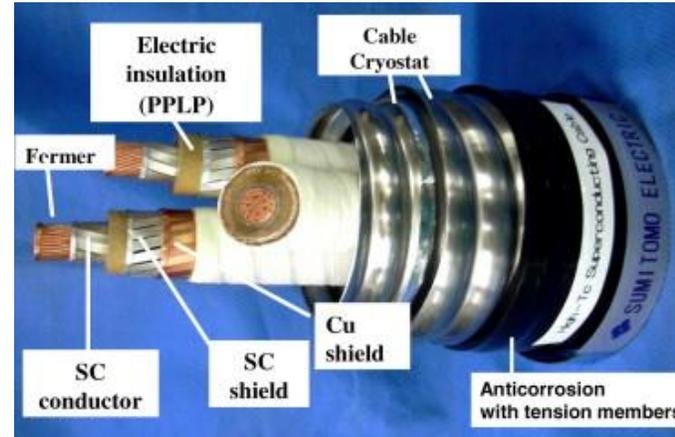

**Separate phases with shared cryostat**



**Separate phases and cryostat**

**voltage**

# The HTS cable system

## Thermohydraulic design:


Distance  $L_{cooling\&pumping}$  between cooling&pumping stations must be compatible with acceptable temperature and pressure, and may differ from overall length  $L_{cable}$  of the cable system

$$\frac{\Delta P}{\Delta x}(D_o, \dot{m}) \leq \frac{P^{in} - P_{min}^{out}}{L_{cooling\&pumping}}$$

$$\frac{\Delta T}{\Delta x}(D_o, \dot{m}) \leq \frac{T^{in} - T_{max}^{out}}{L_{cooling\&pumping}}$$

Outer diameter  $D_o$

Mass flow  $\dot{m}$

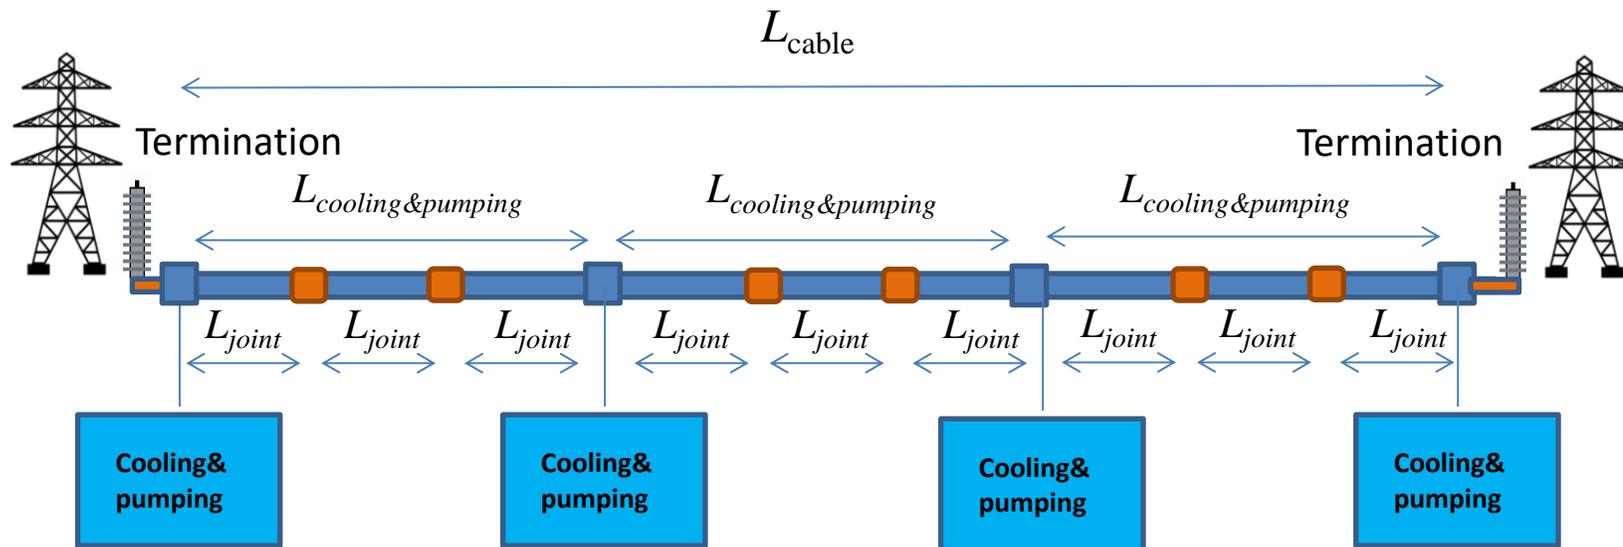


$L_{cooling\&pumping}$  may reach up to 20-30 km, depending on the thermohydraulic design ( $D_o, \dot{m}$ )

Distance  $L_{joint}$  between joints in the range 100-500 m due to manufacturing and transportation limits


Different circulation schemes of coolant between cooling and pumping stations can be adopted depending on the layout of the cable system and in particular:

- Number of phases or poles per cryostat
- Internal or external return path of coolant


*Example 1 - closed-loop circulation of coolant for a long DC cable system made of two monopoles with distinct cryostats*

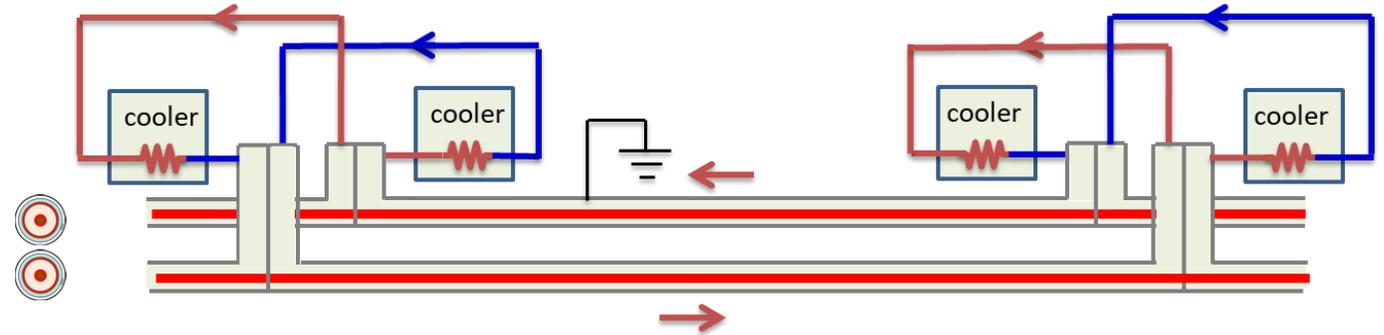


*Example 2 - closed-loop circulation of coolant for the LIPA1 three phase HV cable*

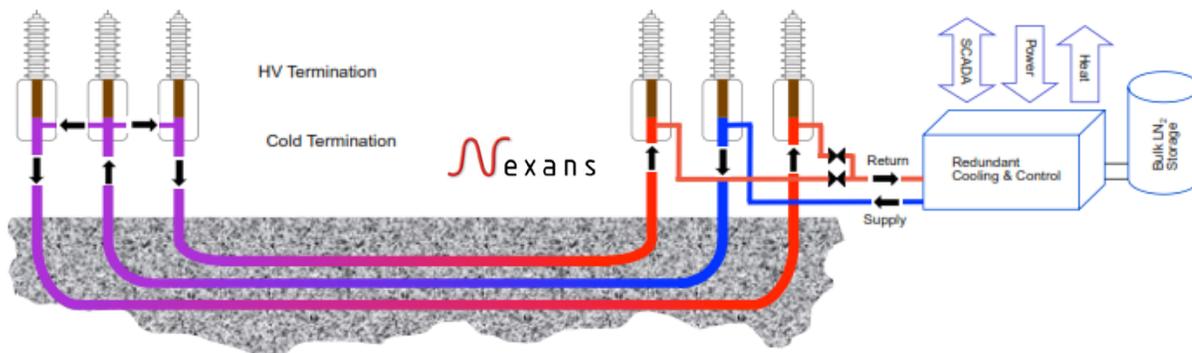

*Example 3 - closed-loop circulation of coolant for the Shingal three phase MV concentric cable*

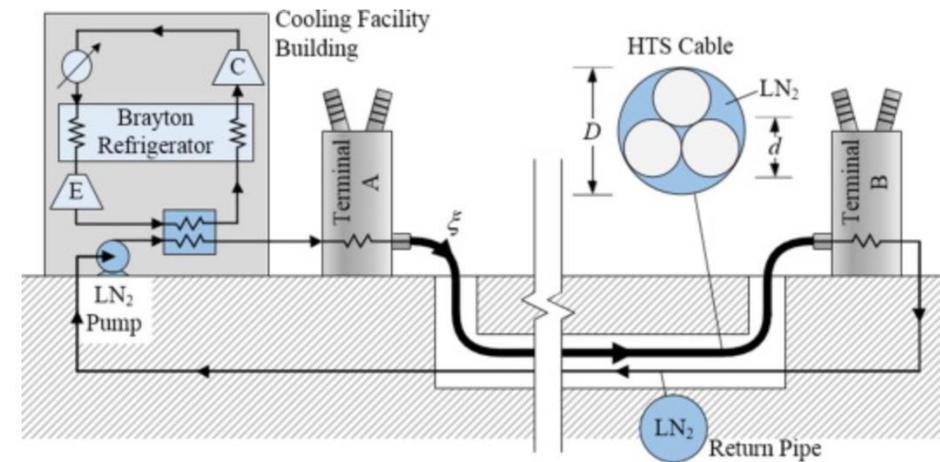

# Motivations for SC power cables - 1. more power and/or less voltage



higher transport current  $I$ , up to 5-10 more than conventional cable through same section

$$P = V I$$

More power at the same voltage

Less voltage at the same power

(+ operation at constant  $T$ )



- Reducing right of way & soil occupation
- Much faster installation

- Use of existing utility civil infrastructures
- Use of other existing civil infrastructures and possibility of new integrated energy infrastructures concepts

- Simplify electric equipment: conversion stages, converters' layout, platform ....

# Motivations for SC power cables - 2. Less losses (cooling included)


Electromagnetic losses per unit length (W/m) of current carrying superconductors:

**AC transport current losses - Hysteretic diffusion of B and J**

$$\dot{q}_{AC} = f \frac{\mu_0 I_c}{\pi} \left[ (1-i) \ln(1-i) + (1+i) \ln(1+i) - i^2 \right] \quad i = \frac{I_{peak}}{I_c}$$

**DC transport current losses - Flux creep**

$$\dot{q}_{DC} = k i^n \quad (W/m) \quad i = \frac{I_{peak}}{I_c}$$

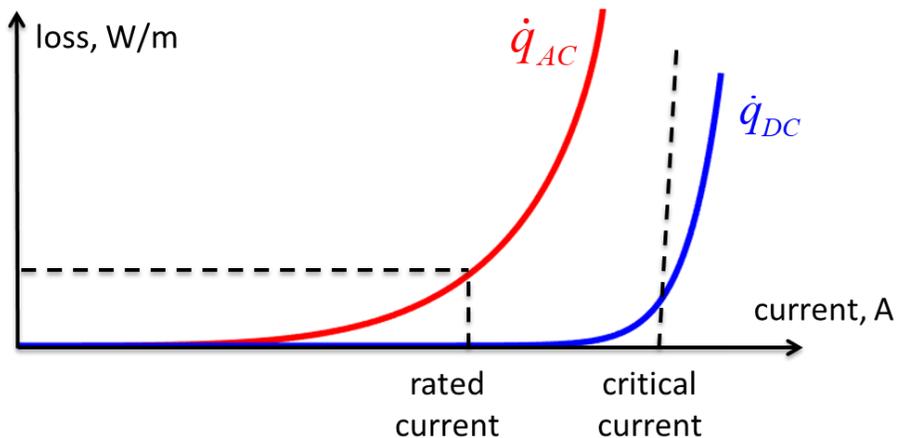

## Typical losses at 65-80 K in cold dielectric power cables


*C. E. Bruzek, "Introduction to superconducting power cable systems", ESAS Summer School, Bologna 2016*

	Dependence	Parameters	Losses at 65-77 K	Losses at RT
<b>Radiation</b>	Room temperature	Super-insulation spacer and diameter	0,5 to 2 W/m	12,5 à 50 W/m
<b>HTS AC losses</b>	Transported current Magnetic field distribution	Cable design (pitches, diameter,..)	0,05 to 1 W/kA.m	1,25 to 15 W/kA.m
<b>Dielectric AC losses</b>	Voltage level	Capacity of the cable and material (tg $\delta$ )	Up to 1 W/m	Up to 12,5 W/m for 220 kV
<b>Eddy current AC on the cryostat</b>	Magnetic field distribution	Cable design (pitches, diameter,..)	0,05 to 0,1 W/kA.m	1,25 to 2,5 W/kA.m

**Absent for DC cables**

For a Cu cable typical 20 W/kAm


**In DC cables no practical loss occurs in the superconductor**

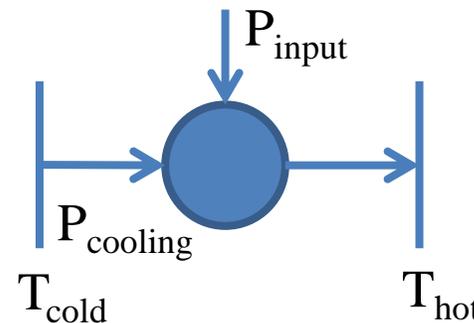

$$COP = \frac{\text{Watt of input power}}{\text{Watt of heat removed}}$$

- Cooling power a SC cable can be estimated to be approximately 25% of the losses of conventional cable system at full load
- Cooling energy over discontinuous operation (e.g. wind power transm.) may increase up to approx. 60%

# State-of-the-Art of SC cable technology – main operational or demonstration projects (AC and DC)

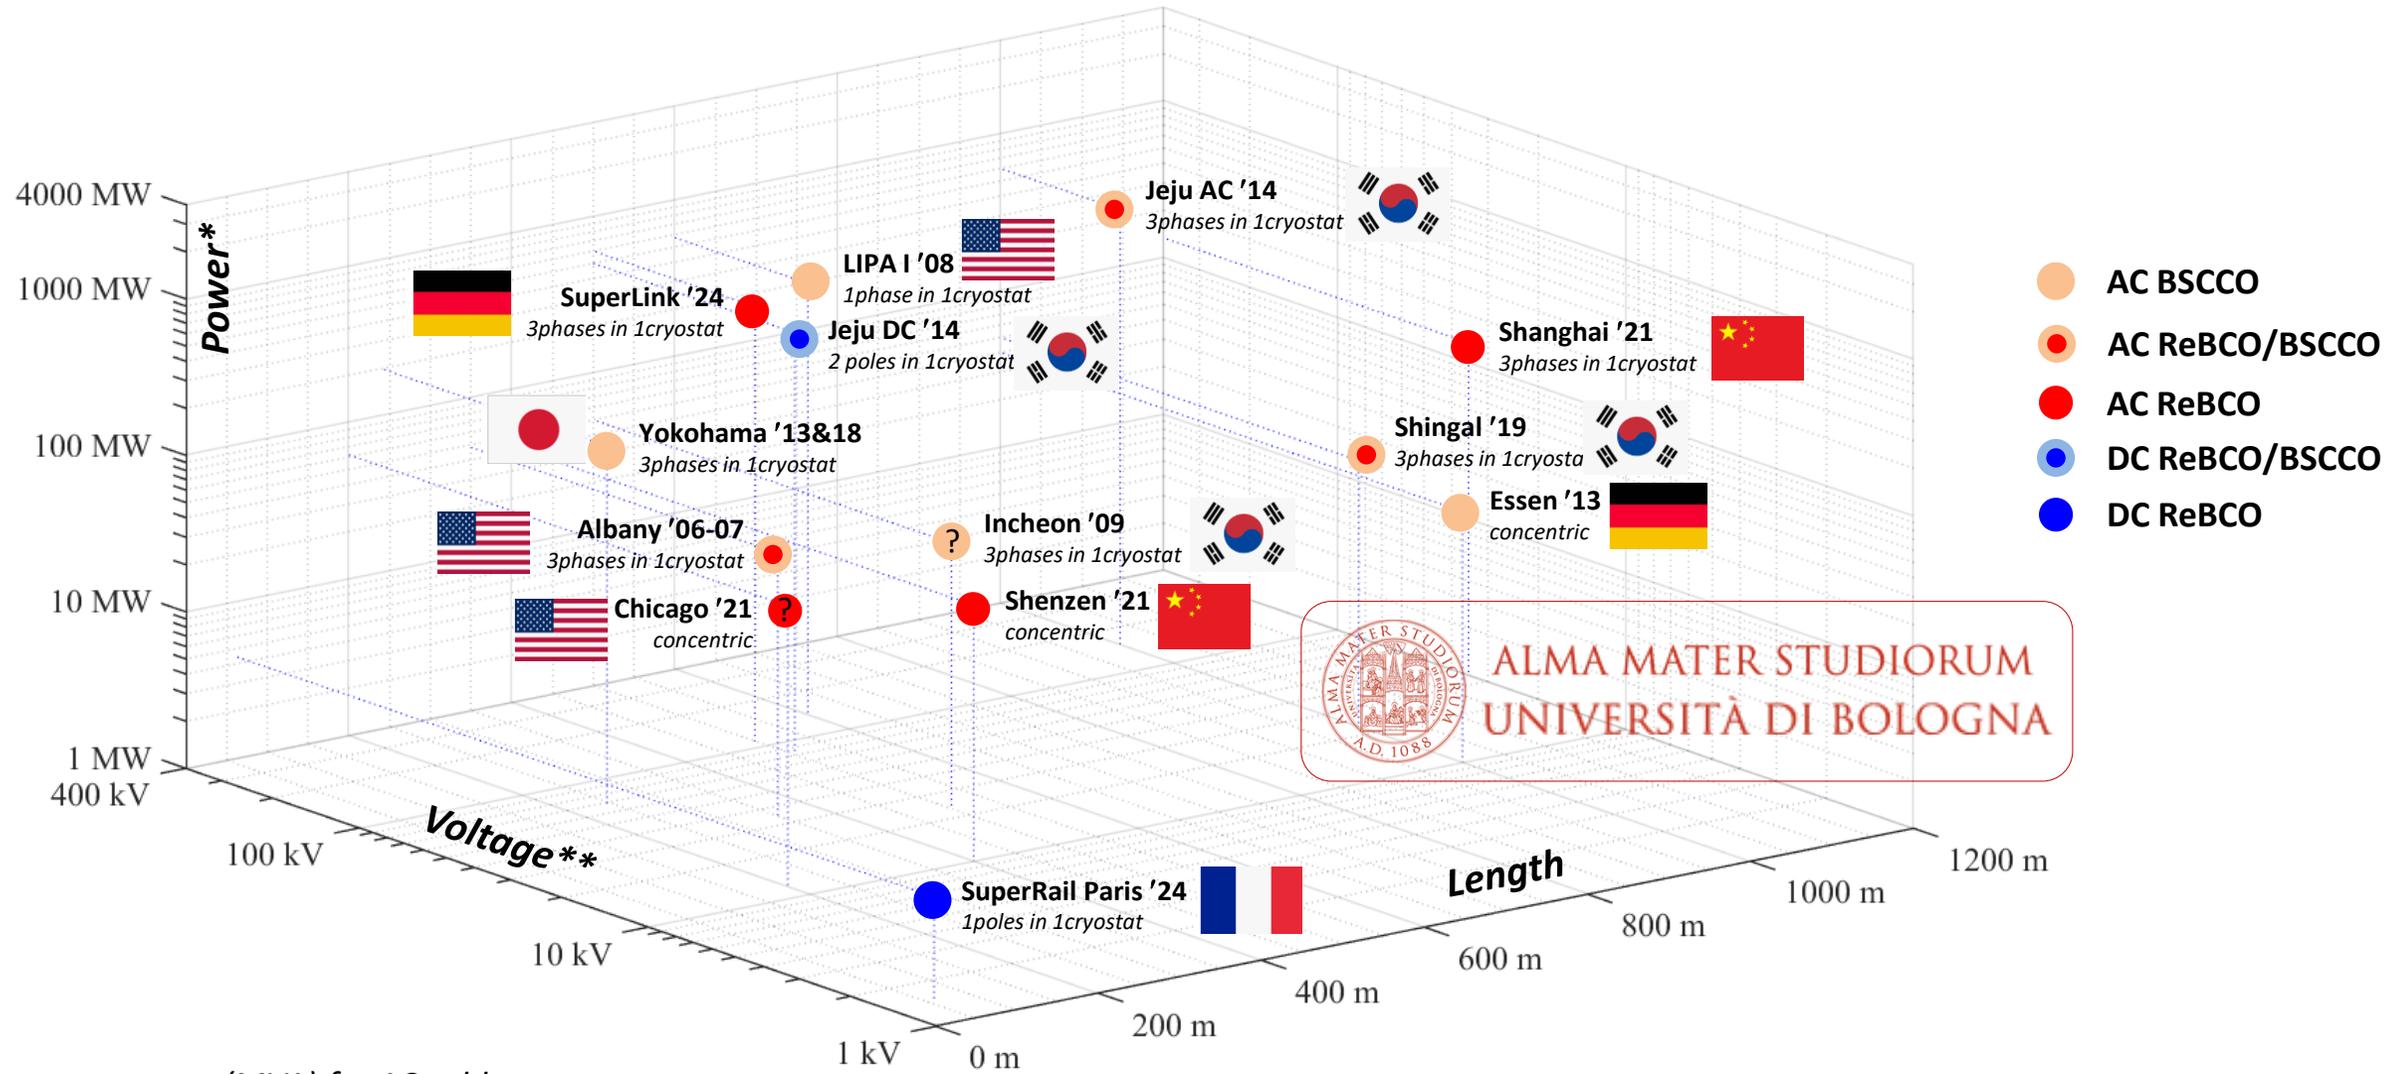

\* Apparent power (MVA) for AC cables

\*\* Line-to-line RMS value for AC cables / Pole-to-ground value for DC cables

## Chicago



AMSc  
12 kV, 3 kA,  
200 m  
Single coaxial design  
HTS material?  
Energized 2021



Figure:  
AMSC

## LIPA



Nexans  
138 kV, 2.4 kA,  
600 m  
Single coaxial design  
BSCCO 2223  
Energized 2008



Figure:  
Nexans

## Shanghai



LS Cable  
35 kV, 133 MVA, 1200 m  
2G HTS  
Energized 2022



# Outline

## HTS power cables:

- **What they are**
    - **General characteristics**
    - **State of the art**
  - **What they can do for you - power cable need today and tomorrow**
    - **How much**
    - **Which type**
- The role of HTS power cables**




# Global electricity demand – today and tomorrow

Growth in global electricity demand is set to accelerate at an average rate of 4% in the coming years due to:

1. Growth of emerging economies
2. “Electrification of everything” to meet decarbonization (i.e. electrification of terrestrial, marine and air transportation, more electric buildings, more electric heating in industry)
3. Exponential growth of new electricity needs: data centers





Over the next years, we will need to add as much power capacity as it took us a century to build

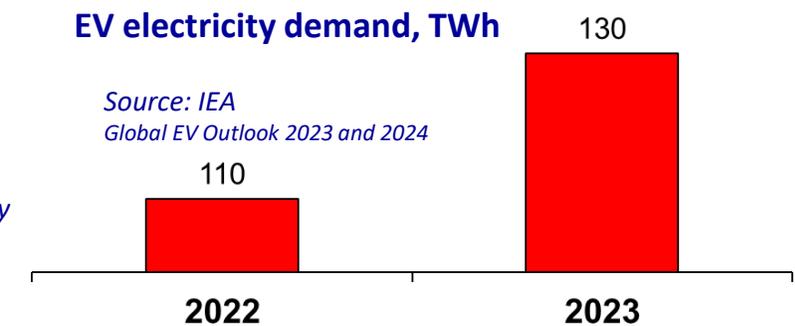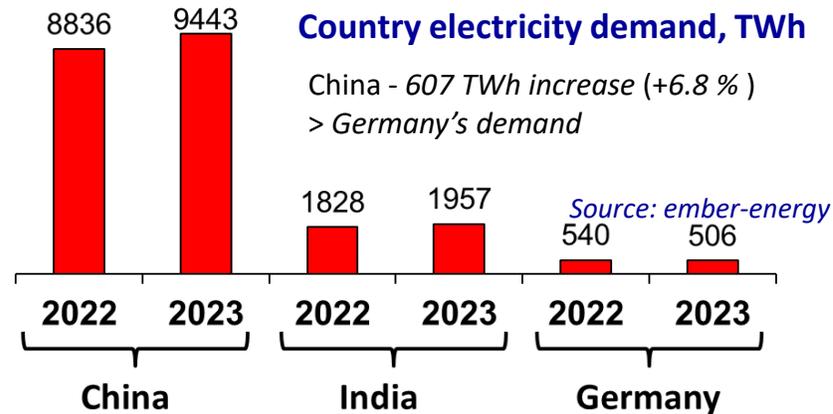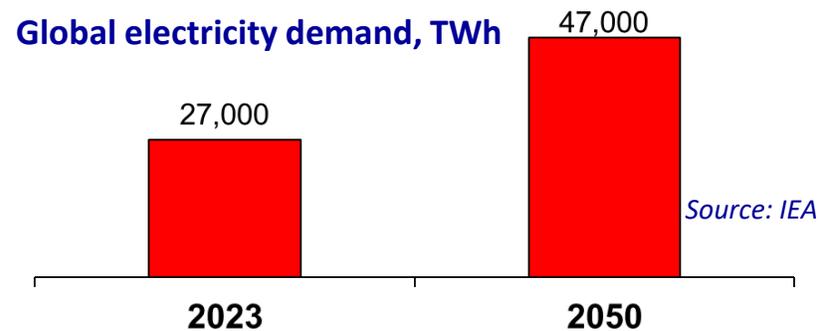

# Addressing the challenge of growing and transforming electricity demand


## Schematic pathway to grid modernization and expansion

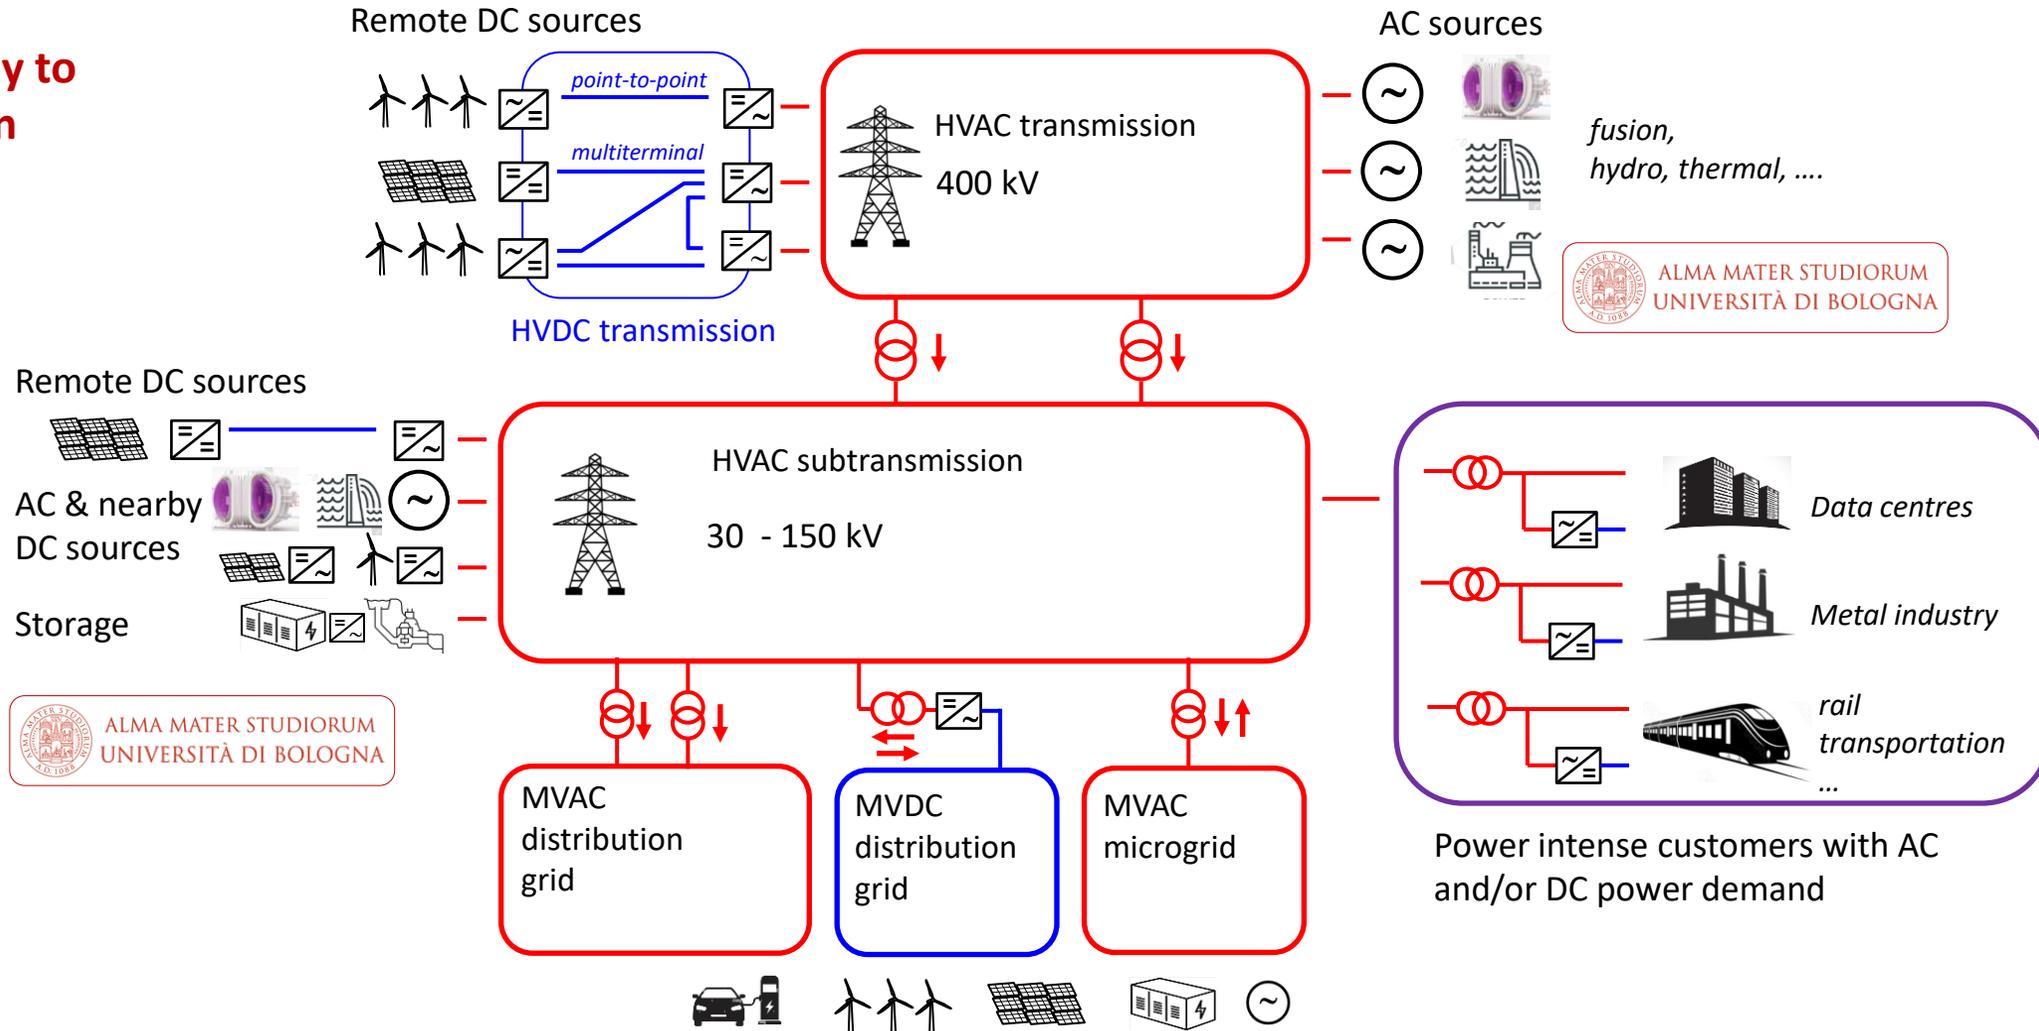

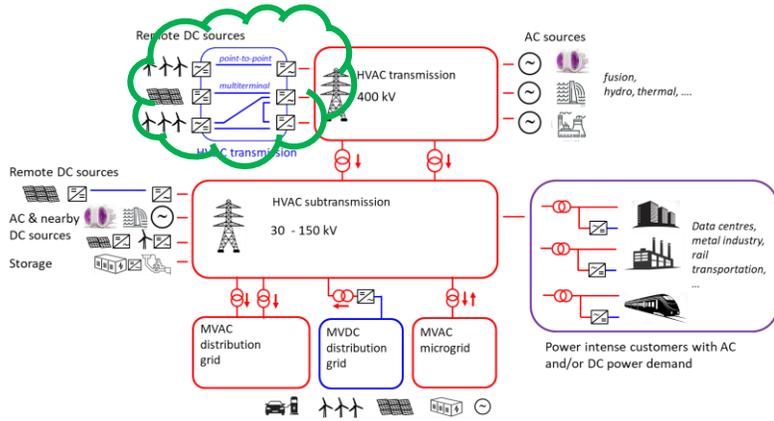

- **EU strategy on offshore renewable energy:** 60 GW of offshore wind and at least 1 GW of ocean energy by 2030, with a view to reach by 2050 300 GW and 40 GW
- **EU Solar Energy Strategy:** over 320 GW of solar photovoltaic by 2025 (more than doubling compared to 2020) and almost 600 GW by 2030
- **India's wind power potential** is estimated to be 695.50 GW at 120 meters and 1163.9 GW at 150 meters above ground level.

## continental transmission grid

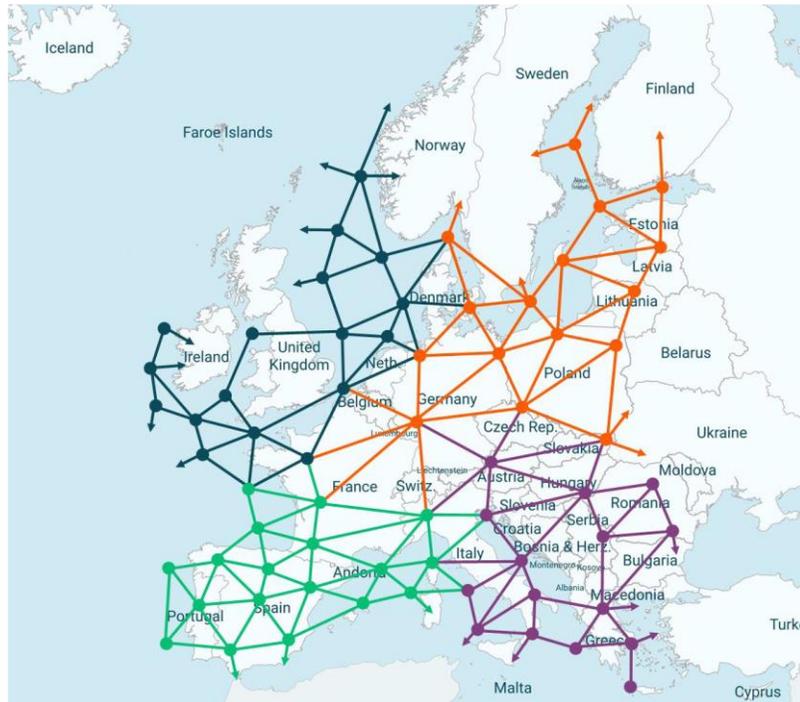


- **Extremely high-power density DC corridors are needed for implementing this vision which can only be achieved through HTS technology**

*Superconductors will do for electricity what fiber optic cables did for telecoms by replacing the twisted pair. They will revolutionise power transfer, enabling ultra high capacity unobtrusive transmission.”*

**Pat Cox, SuperNode Chairman and Former President of the European Parliament**



# European Project SCARLET (2022-2027)

- ❑ **Goal:** develop and industrially manufacture superconducting cable systems at the gigawatt level, bringing them to the last qualification step before commercialization
- ❑ Expertise from **15** industry and research organisations in the fields of material sciences, cryogenics, energy systems and electrical engineering
- ❑ 3 demonstration work packages
  - long-length onshore superconducting cable systems (WP2)
  - MgB<sub>2</sub> cables in liquid hydrogen (WP4)
  - system protection (WP5)
- ❑ 1 work package on architectures of offshore superconducting cable systems (WP3)
- ❑ 1 work package for integration studies and economic evaluation (WP1)
- ❑ lastly, work packages for communication and coordination (WP6)


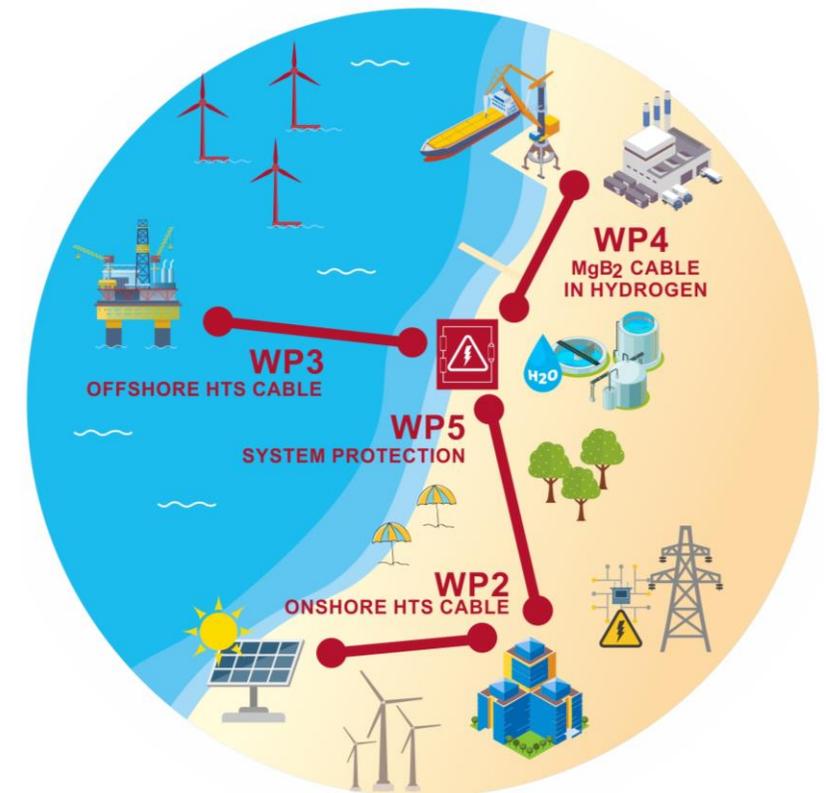


# The selected case: unidirectional MVDC grid connection 1 GW offshore wind park

## HVDC conventional links

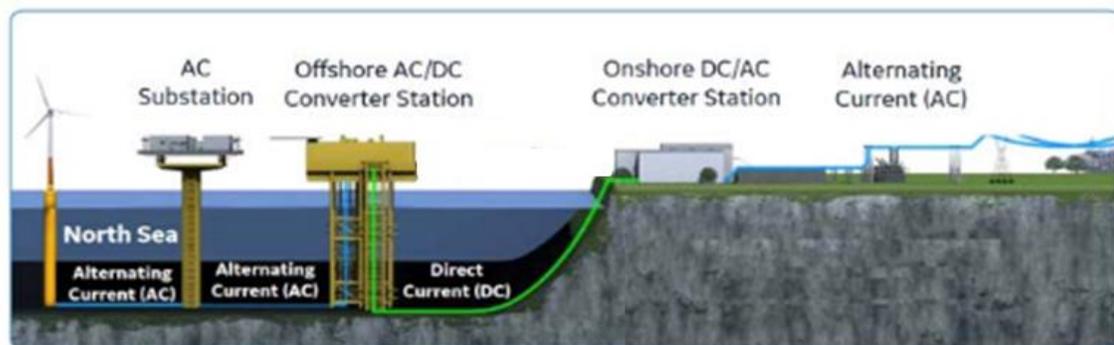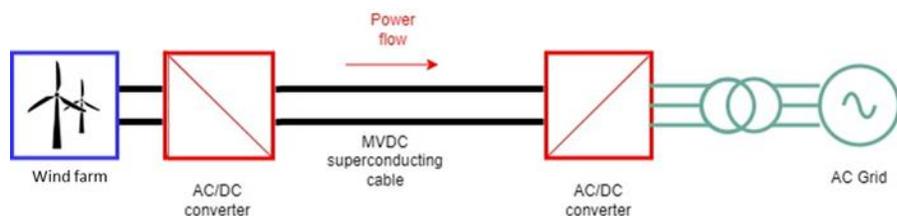


## MVDC Superconducting links

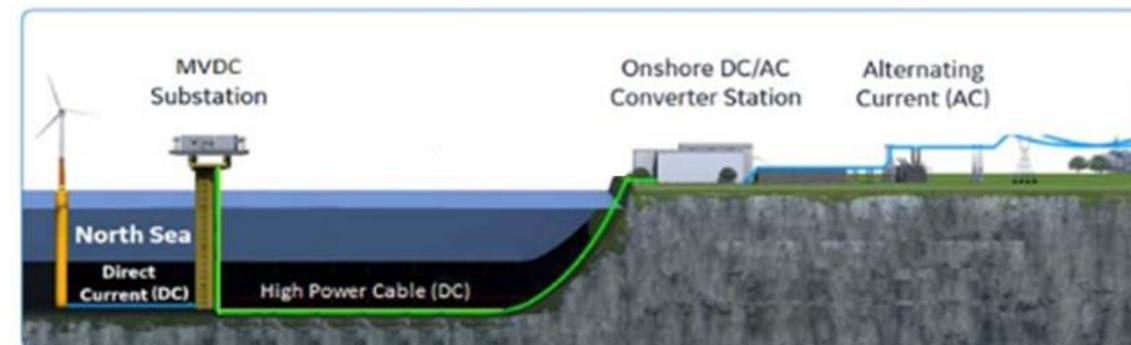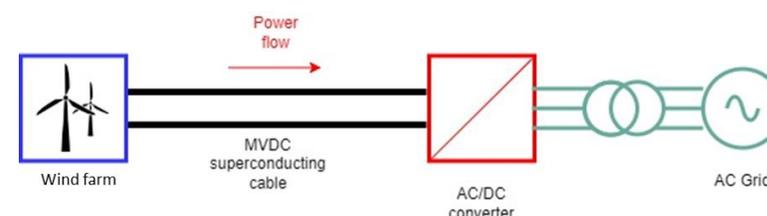

**No offshore substation**

	Cu/XLPE
Voltage, kVdc	±525
Current, kAdc	0.93
Temperature	70-90 C°
Cooling, kW/km	40
Cooling of terminations, kW	---

	HTS/LN2	MgB2/LH2
Voltage, kVdc	±50	±25
Current, kAdc	10	20
Temperature	65-75 K	20 K
Cooling, kW/km	23	36
Cooling of terminations, kW	30	30

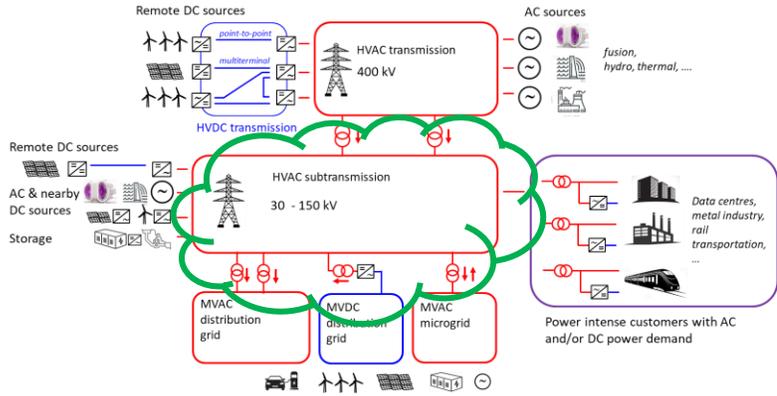

- Delivering abundant renewable power to users will require increasing the capacity existing subtransmission grid with minimum infrastructural impact

SWM: How do you transfer 500 MW across...?!?

NKT



Courtesy of Dag Willen, NKT



München

# 150 m Demo field test

110 kV Bauereinsatzkabel (BEK)

J2-AP joint

J2-E joint

S1 Splitterbox

T5 Terminations

Water chiller

Cryo-cooler

LN2

Synthetic Current Source

110 kV

Cable & Cryostat


Successful installation of cryostat, manufacturing of 600 m cable, installation of 3 x 150 m cable, joints, splitterboxes and terminations under realistic conditions

Courtesy of Dag Willen, NKT

Feasibility of 110 kV, 500 MW 2G HTS cables in the grid demonstrated

- Similar projects based on 1G HTS were demonstrated in US (LIPA 2008), Japan (Yokohama 2013) and Korea (Jeju 2014) through infield operation




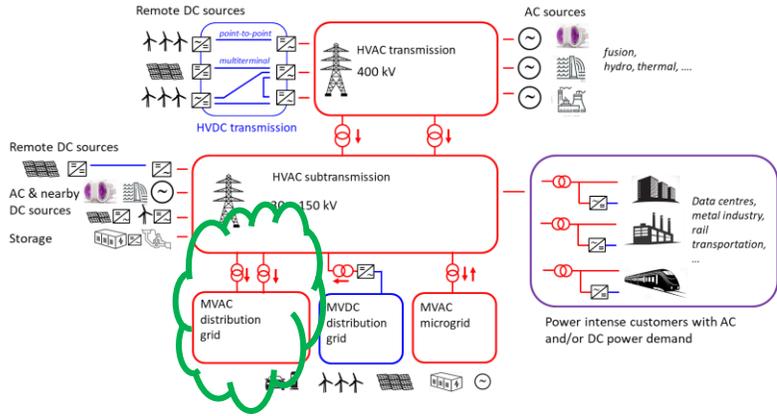


- Meeting the increasing load demand of congested areas will require the upgrade and/or the reconception of distribution grids



Conventional Situation in Essen

HTS Cable plus FCL Situation in Essen

**The Ampacity Project in Essen-Germany**

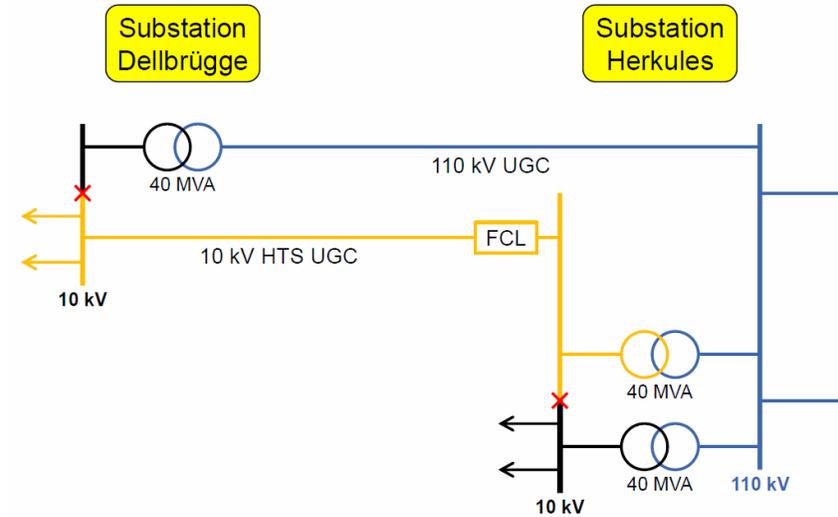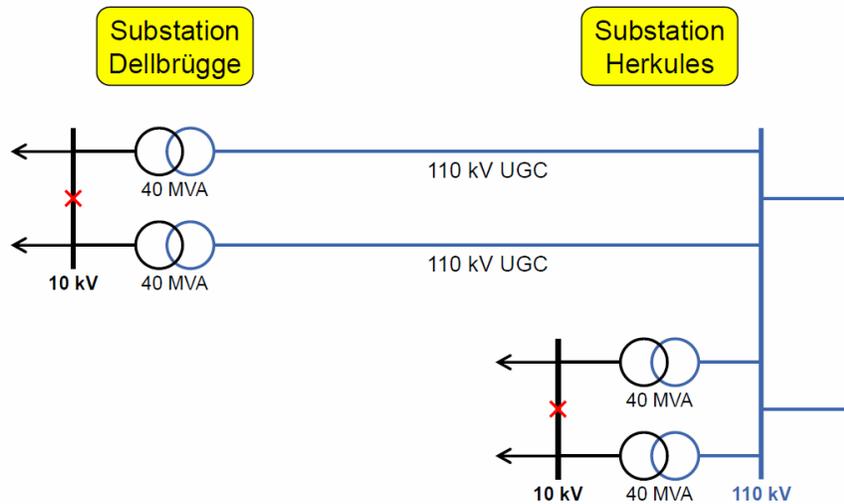


M. Noe, EUCAS2017, Short Course on Power Applications

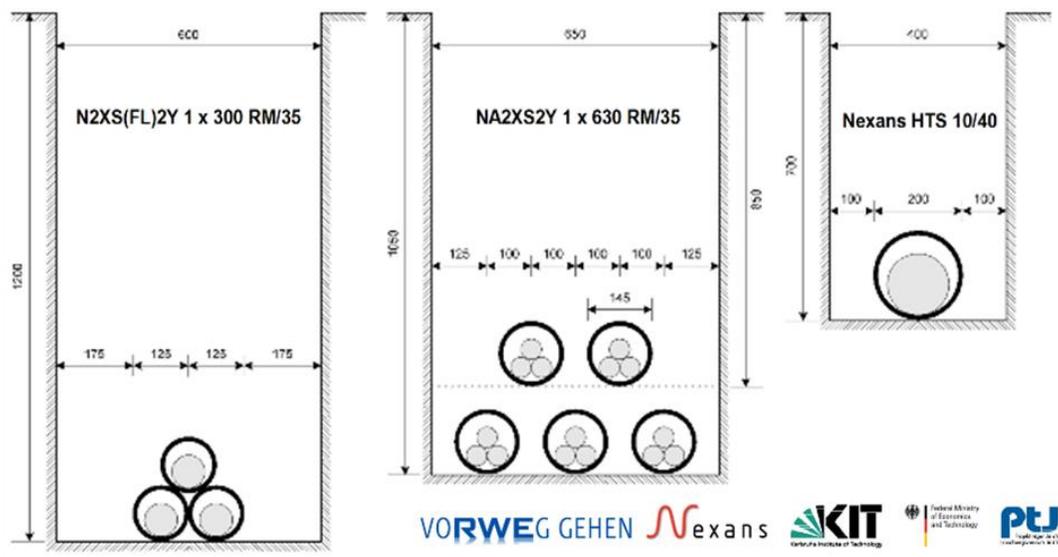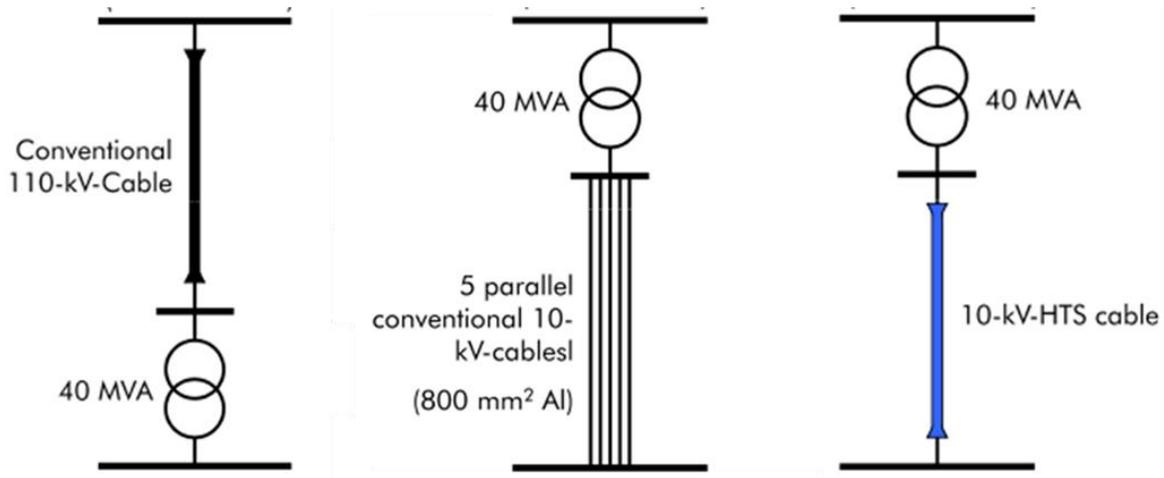

*Delivery of 40 MVA at the city center achieved with exploiting existing infrastructure and with no need of HV transformer*

- First of its kind solution successfully demonstrated in 2013 by means of 1G HTS
- Followed by Shingal cable project put in operation in Korea in 2019
- Similar projects based on 2G HTS demonstrated in Chicago, Shanghai and Shenzhen in 2021 through infield operation



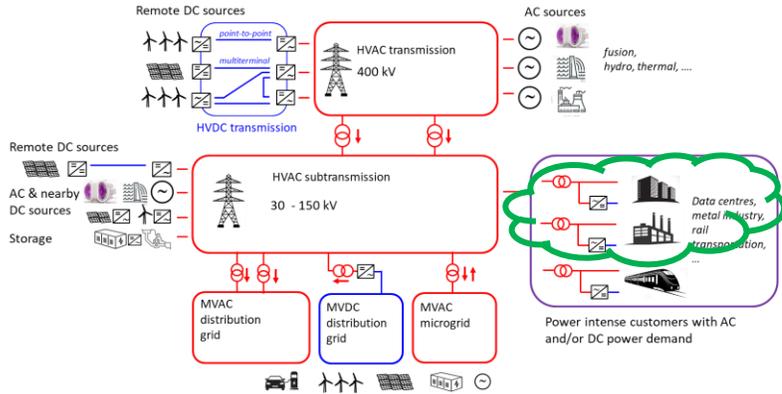


- Supplying established (metal industry) and emerging (data centers) power-intensive and current-intensive DC customers

## From DEMO200 to SuprAI

### • DEMO200

- R&D-Demonstrator 200 kA, world record
- Aluminium smelter applications
- Test successfully performed 2024-09,

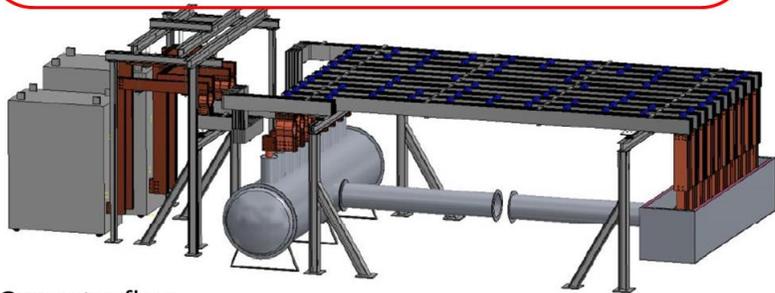


Gesamtaufbau

VESC 2024

Dr. Wolfgang Reiser

Courtesy of Wolfgang Reiser VESC


- **Step 1:** DEMO200, partially funded by the German Government → [www.demo200.de](http://www.demo200.de)  
→ Goal reached in 2024-IV
- **Step 2:** Installation of 200 kA superconductor busbar at Trimet smelter in Hamburg in parallel to existing aluminium busbars (yellow line)  
→ Cut down of electrical losses by **approx. 90%**

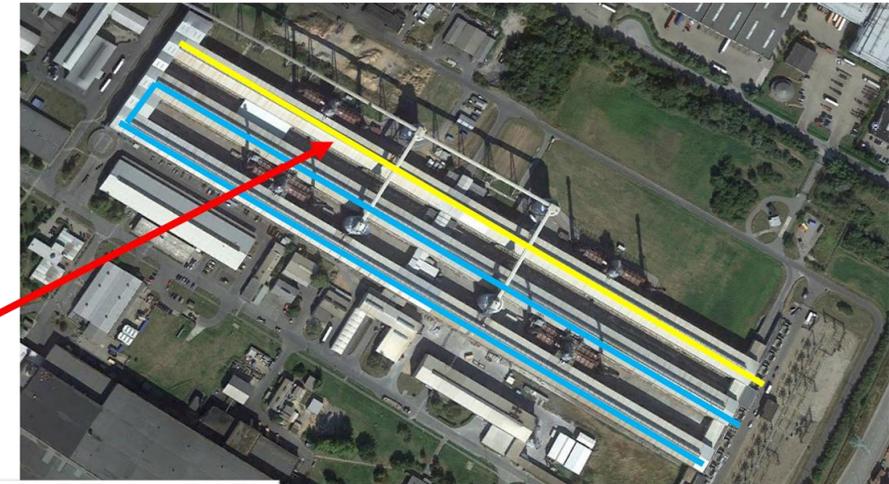

- Practical field test at Trimet as a step for grid approval
  - Low-loss transport
  - 2 GW:  $\pm 50\text{kV}/20\text{kA}$  or  $\pm 20\text{kV}/50\text{kA}$  instead of conventional  $\pm 500\text{kV}/2\text{kA}$



# Conventional vs. Superconducting Hyper Scale DataCenters

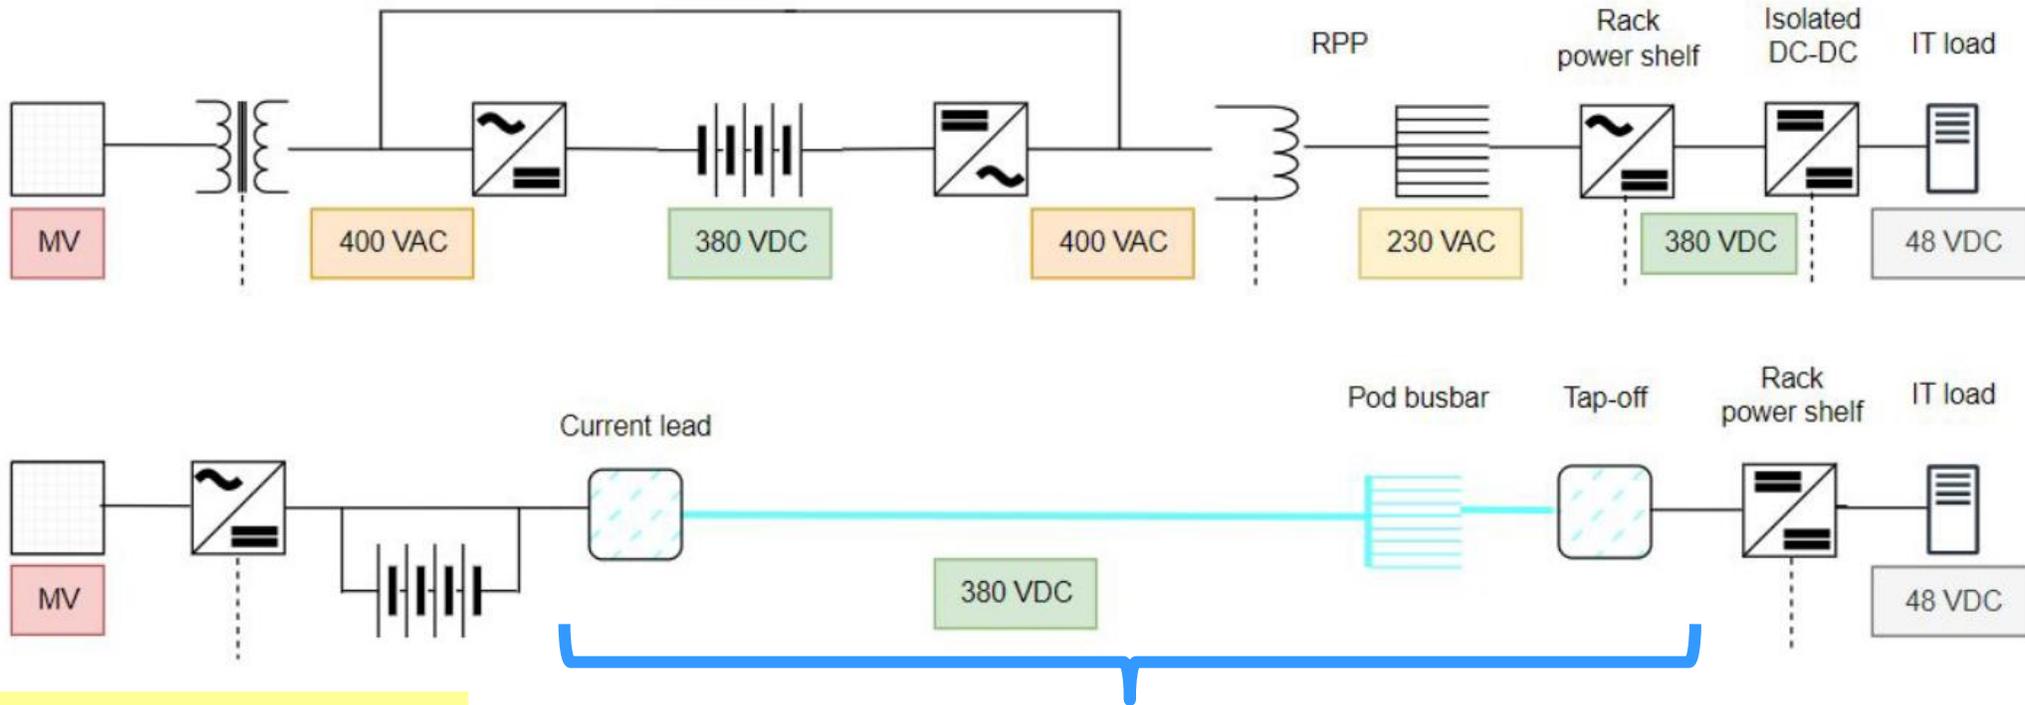


Conventional

Superconducting

- Motivation**
- Increased demand for Hyperscale DataCenters
  - Increased Power per Rack
    - Up to 200 kW per Rack for AI-Applications
  - Increased Efficiency Demand

**Superconducting Busbar with multiple Tap-offs**  
**Reduction of Power Conversion Steps**  
**DC Distribution: Up to 100 MW on Low Voltage**

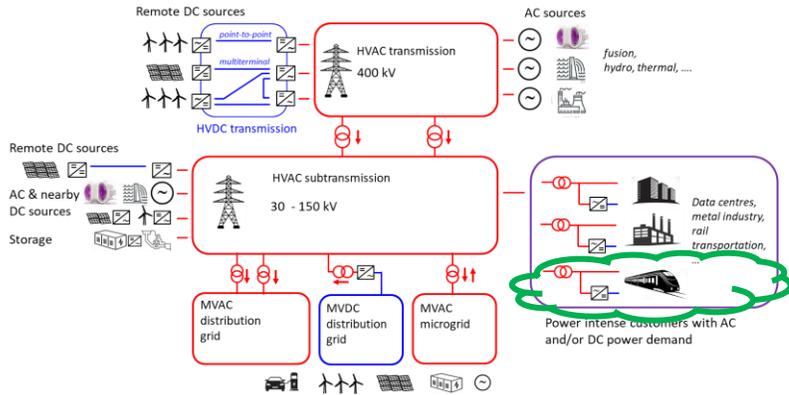


- Upgrade of the railway power supply infrastructure

Reinforcement of Paris Montparnasse train station  
 28 tracks, 200 000 passengers/day on 750 trains  
 50 Millions of passengers in 2020, 90 Millions in 2030




Existing rights of way saturated  
 only  $2 \times \Phi 100$  mm conduit left  
 =  $2 \times 400$  mm<sup>2</sup> copper cable  
 =  $2 \times 500$  A reinforcement  
 Instead of the required 3000 A

*Courtesy of Loïc Quéval,  
 GeePs, CentraleSupélec,*

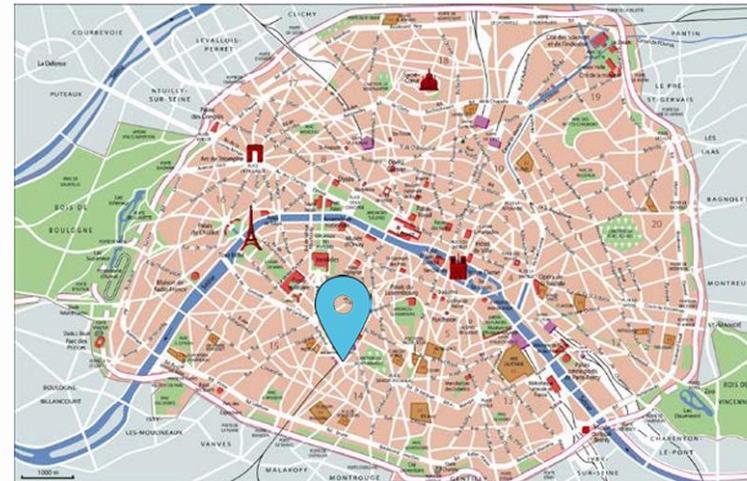

4.5 MW of nominal power (3000 A @1500 VDC)  
 10.5 MW of inrush power (7000 A)  
 Fault current of 67 kA during 100 ms

# Summary of type test at SNCF AEF

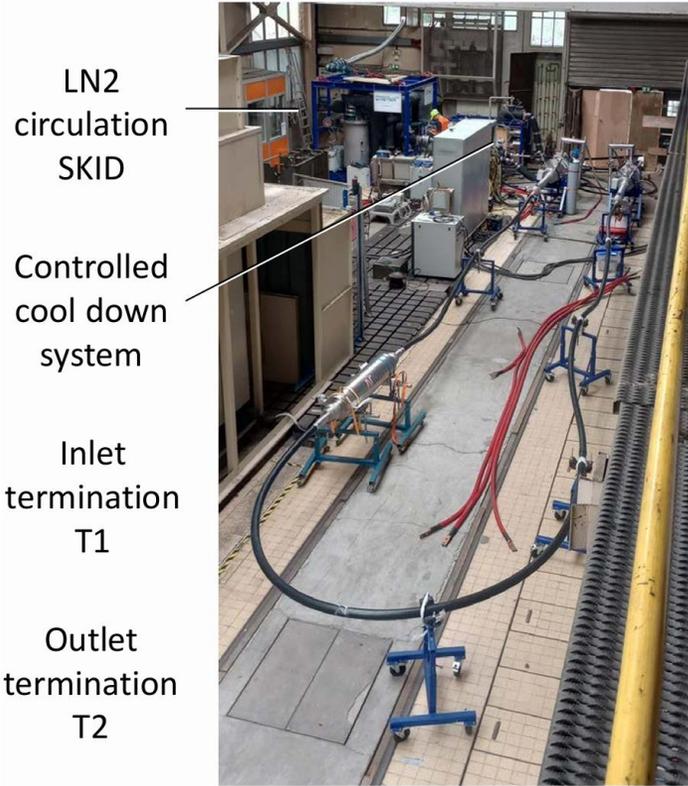

Test	Results
Thermal cycles	✓
Pressure	✓
Dielectric	✓
Lightning impulse	✓
Nominal current	✓
System losses & pressure drop	✓
Fault current & recovery time	✓
V-I characteristic	✓

4.5 MW of nominal power (3000 A @1500 VDC) successfully developed and qualified

Commissioning for final installation started in 2025

# Conclusion

**HTS power cables system have been widely established through many demonstration projects worldwide**

**Cheap and abundant coated conductors are needed to improve penetration and to finally enable mass adoption of HTS power cable technology in the energy sector, providing a vital asset for decarbonization.**

**Wire should be optimized for low field operation in the range 65-77 K**

**Thanks for your attention**

**[antonio.morandi@unibo.it](mailto:antonio.morandi@unibo.it)**