

Alarm statistics w30-31

G. Rigoletti




EP-DT
Detector Technologies

Alarms statistics



<https://gcs-email-alarms-visualization.app.cern.ch/>

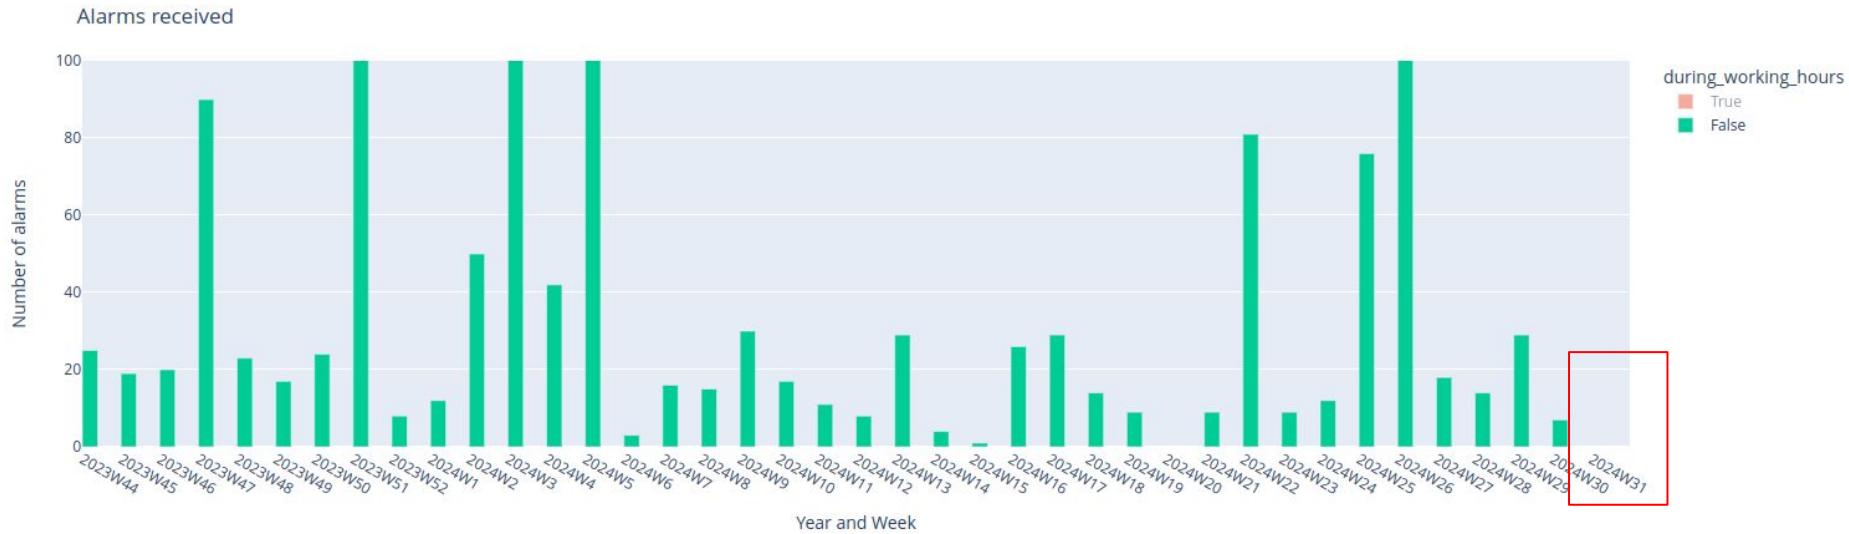

Alarms w30-31



Gianluca Piquet (25/07 - 01/07)

MMG system stopped

- Issues with the profibus network. Followed up by Gianluca, still under investigation. System to be restarted as soon as possible

Not Piquet but:

CMS RPC Distribution pressure sensors failing: [5961](#), [5964](#)

- Call from CR everytime the sensor failed. Followed up by Andrea + Gianluca. If PTxx04 \Rightarrow moved regulation to PTxx05. If PTxx25 \Rightarrow alarm blocked and rack restarted