



MICE RF System

Power Supplies, Control and Monitoring
Status report


February 2012

Chris White, STFC Daresbury Laboratory
MICE Collaboration Meeting CM32, RAL



MICE RF SYSTEM (VI) 8 MW/ 8 Cavities


10/06/2004

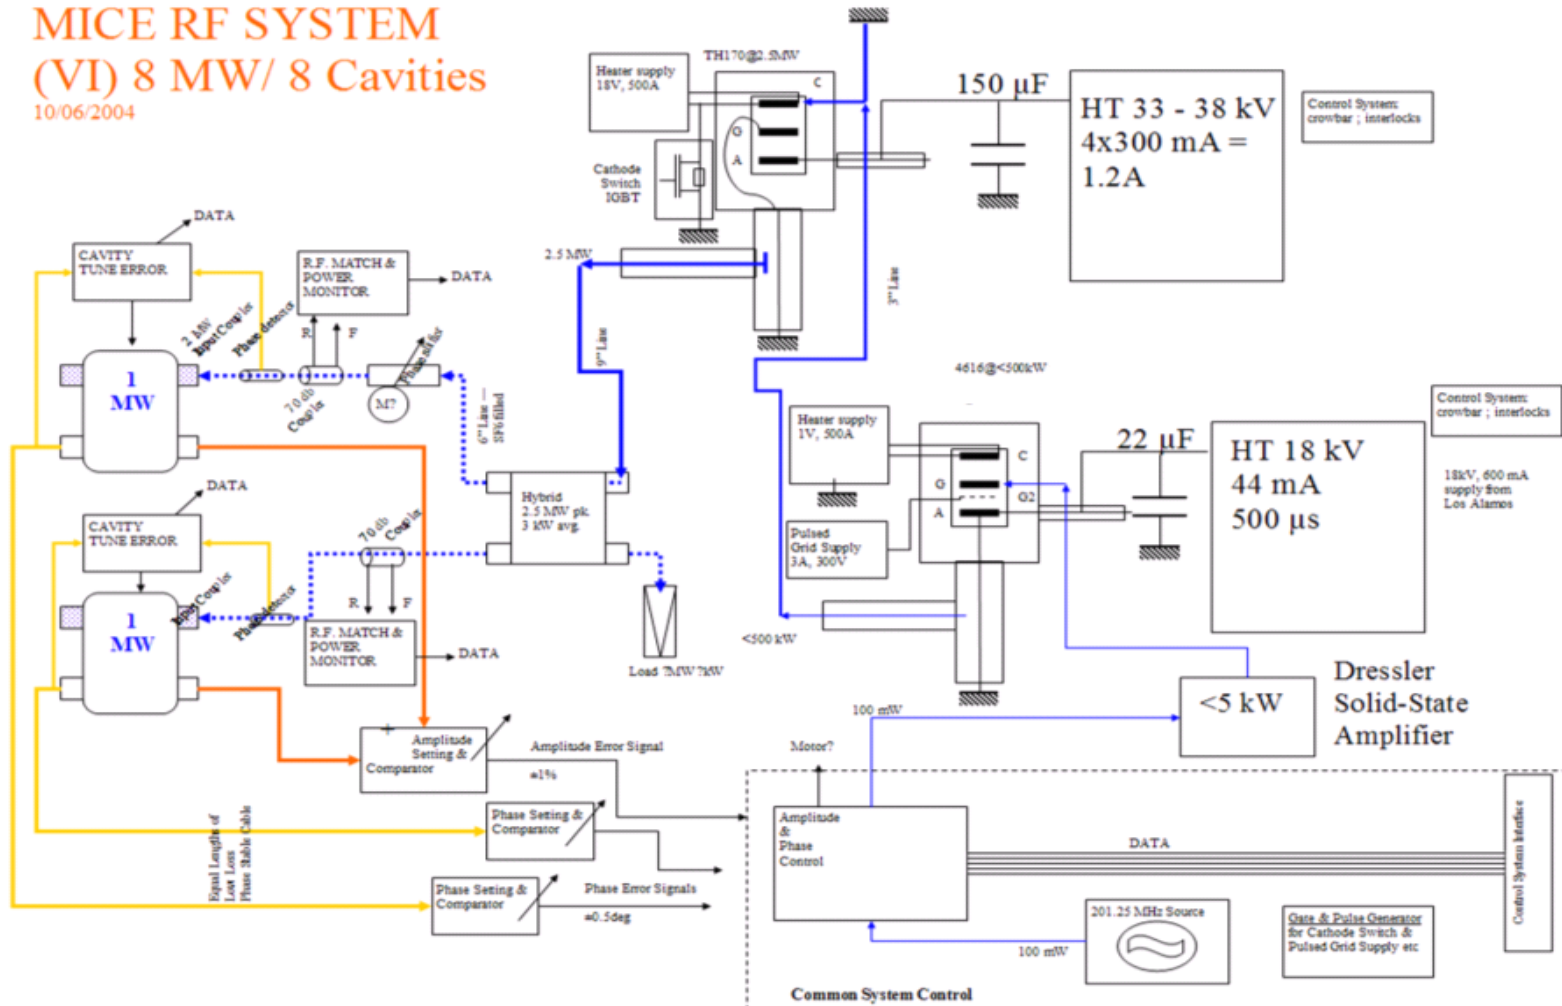




MICE RF SYSTEM (VI) 8 MW/ 8 Cavities

10/06/2004

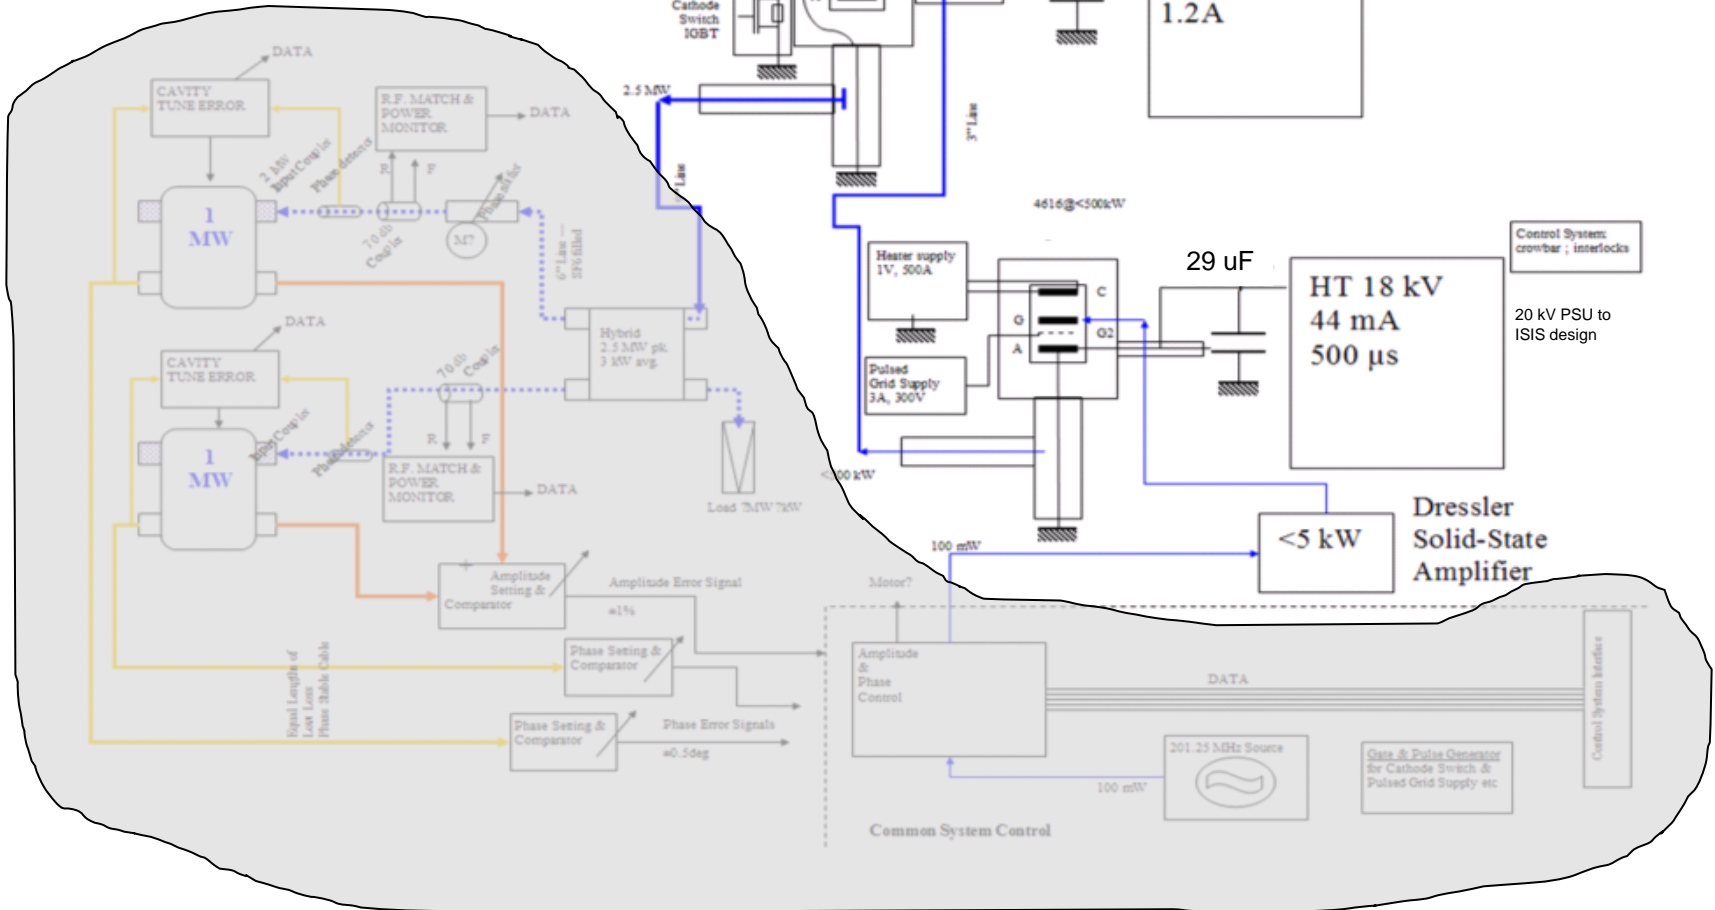




20 kV Power Supply for 4616

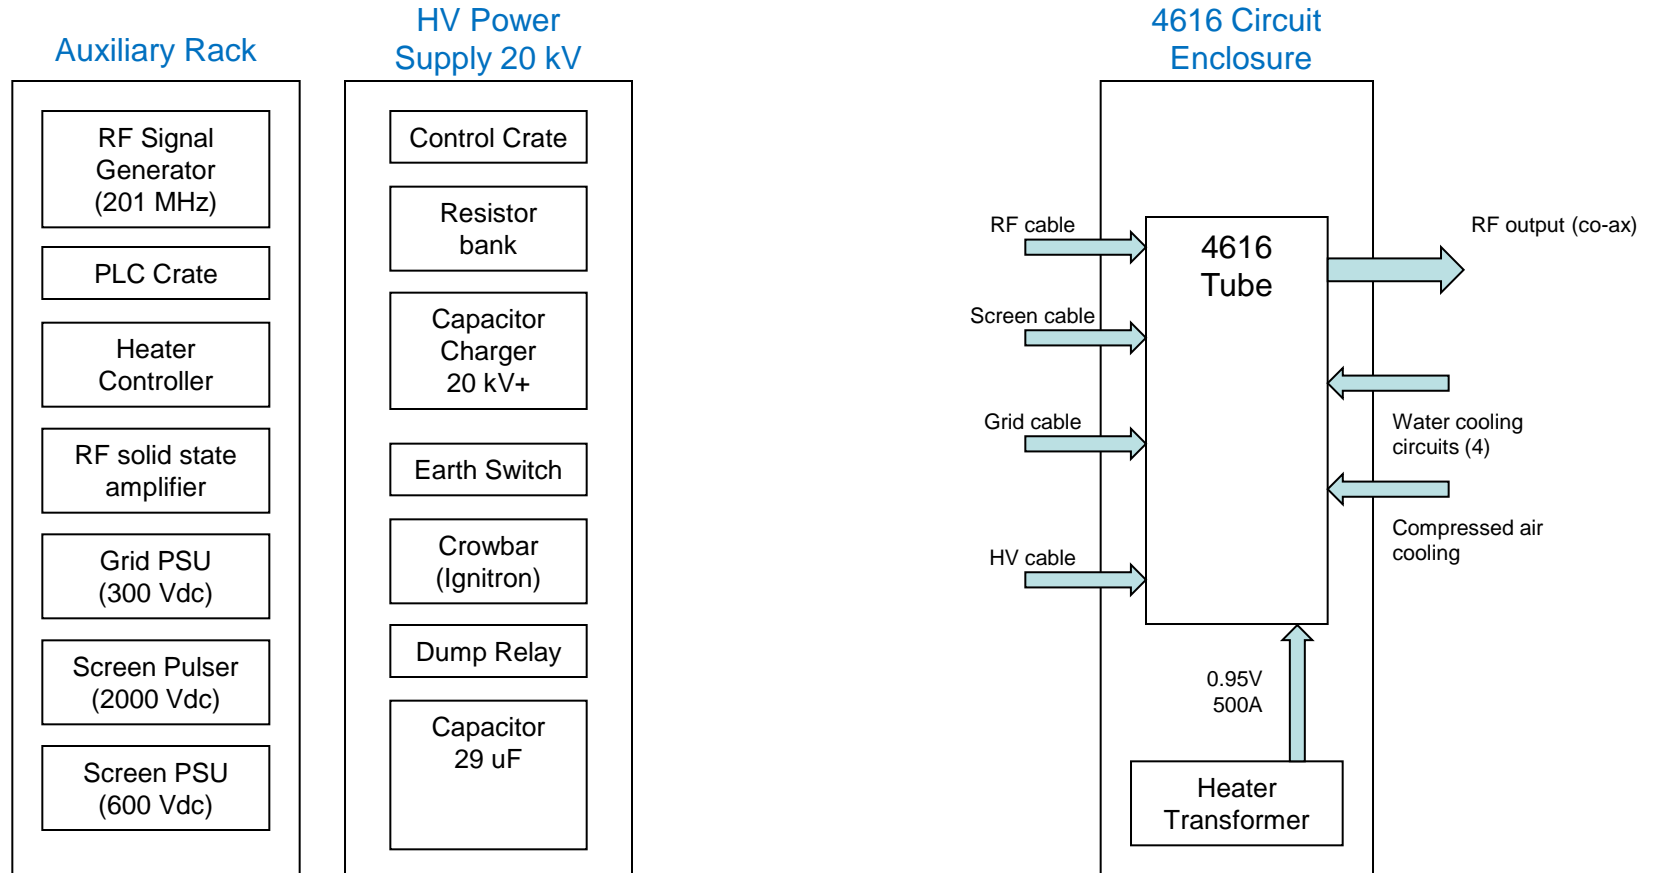



38 kV Power Supply for TH116

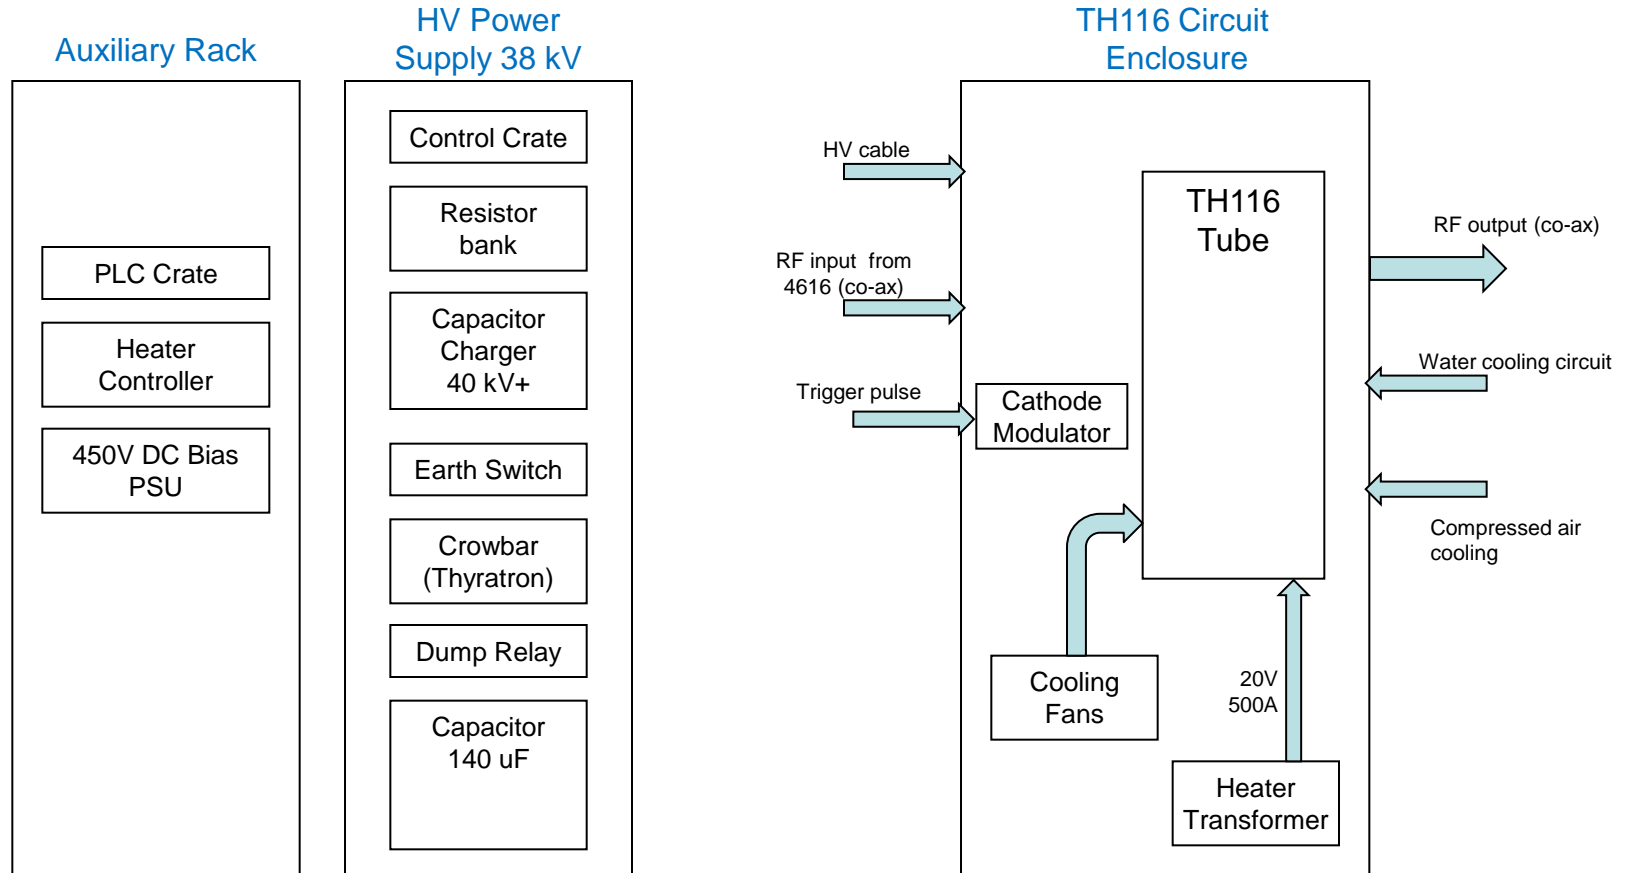



Daresbury Laboratory - Plant Room 1 - RF Test Area





Cooling Water Systems (DL)


- DL site cooling system decommissioned
- Ex-SRS twin-circuit chiller installed
 - Demin for amplifiers
 - Glycol for load
- Now fully operational






TH116 Circuit #1

- Mechanically complete
- New fans fitted
- Cathode modulator built
- Motorised tuners
- Electrical control panel
- Heater controller
- Safety interlocks
- Tested to 1 MW RF output

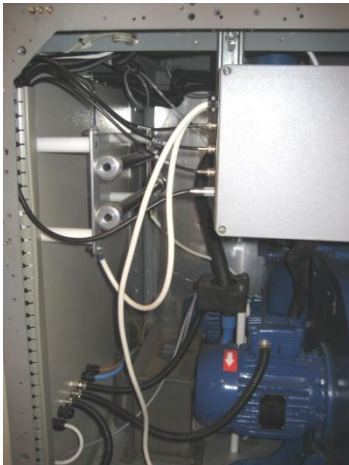




Cathode Modulator

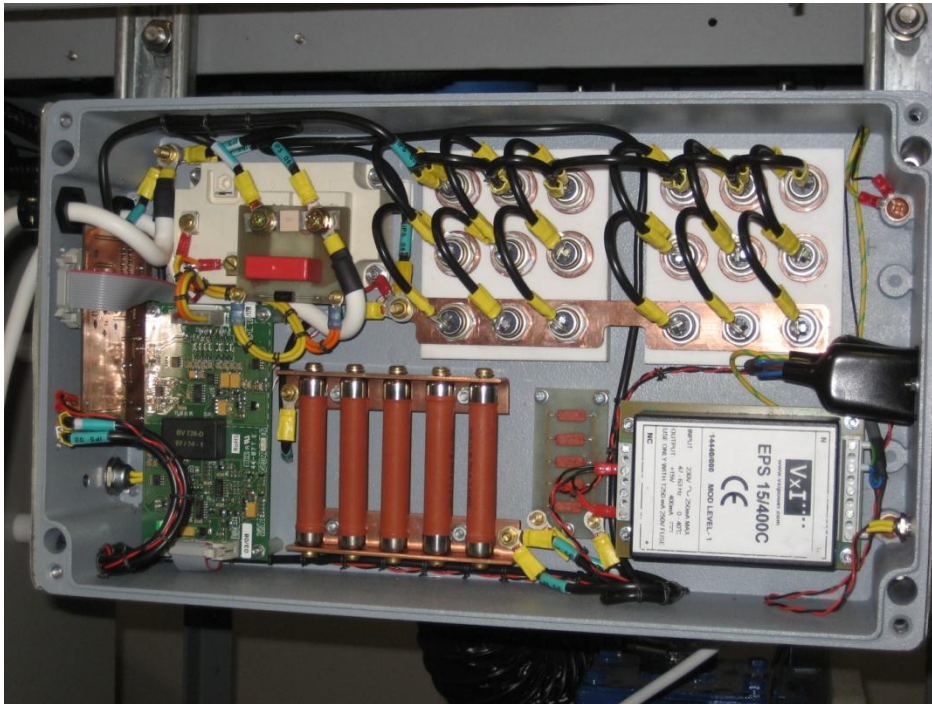

- IGBT switch
- IGBT control board
- Potential divider
- Zener diode array

- Fully operational
- Second unit now complete

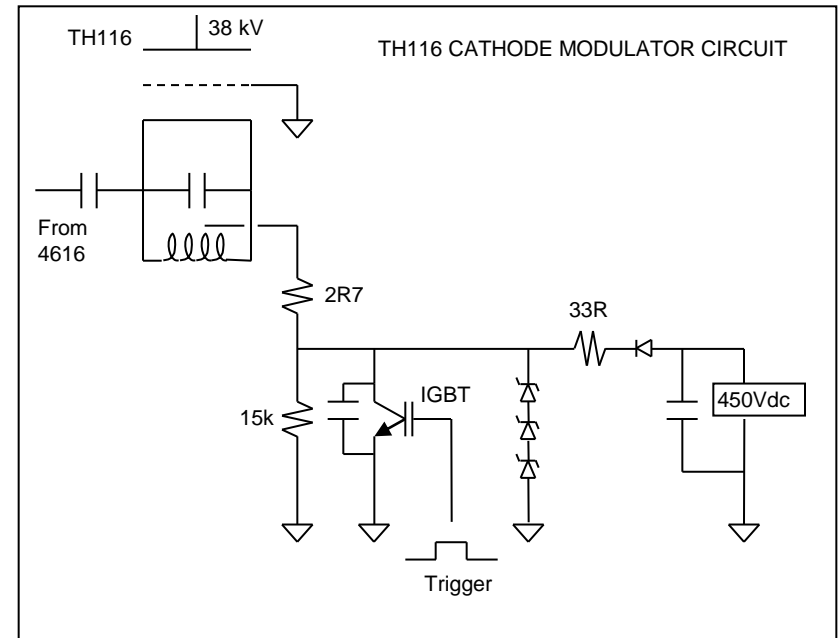




Circuit tuning motors





TH116 Electrical Control Panel

- Fan control-gear
- Heater controller (thyristor)
- Circuit-breakers
- Tuning control relays

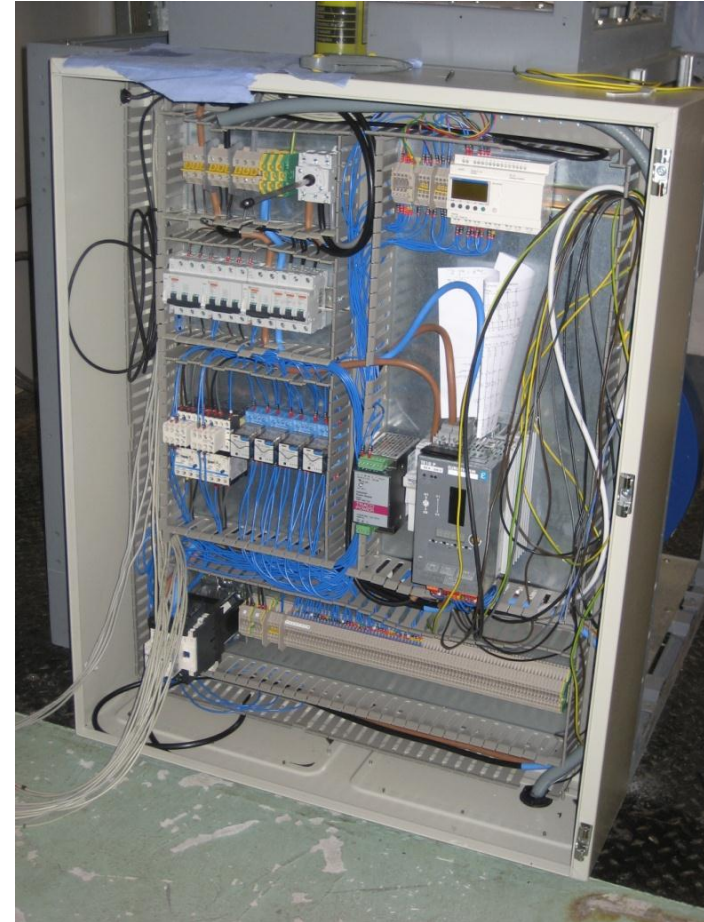




TH116 38kV Power Supply


- 2 x 70 μF Capacitors
- Crowbar (thyatron)
- Control unit
- Power module
- Dump relay
- Earth switch
- Charger (40 kV)
- Resistors



Crowbar (Thyatron)

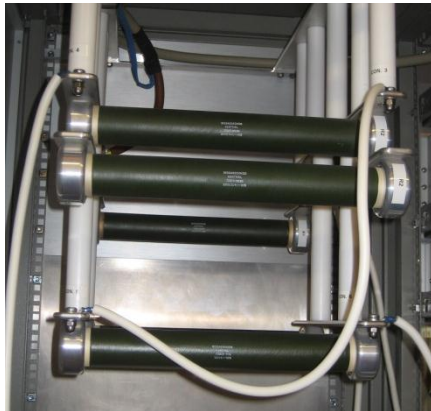


HV Resistors

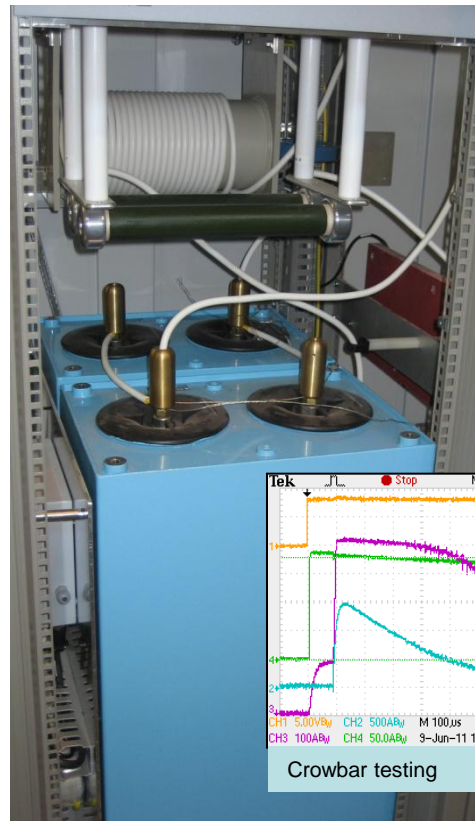

HV Capacitors (140 μF)



Power Supply Rack (Front)

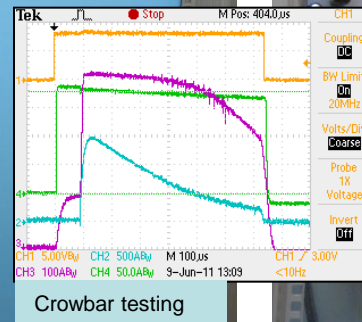



RF HV Power Supplies - Components



20 kV PSU & Aux. rack – front view



TH116 Circuit (lower part)




HV PSU Control Unit



38 kV PSU – rear view



38 kV PSU – resistor bank

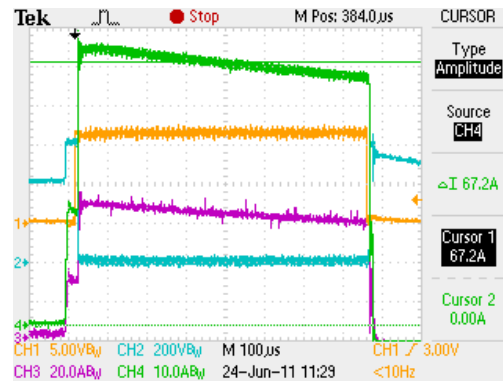


38 kV PSU – 1 MW RF output



Crowbar (38 kV Thyatron)




RF Control & Monitoring System

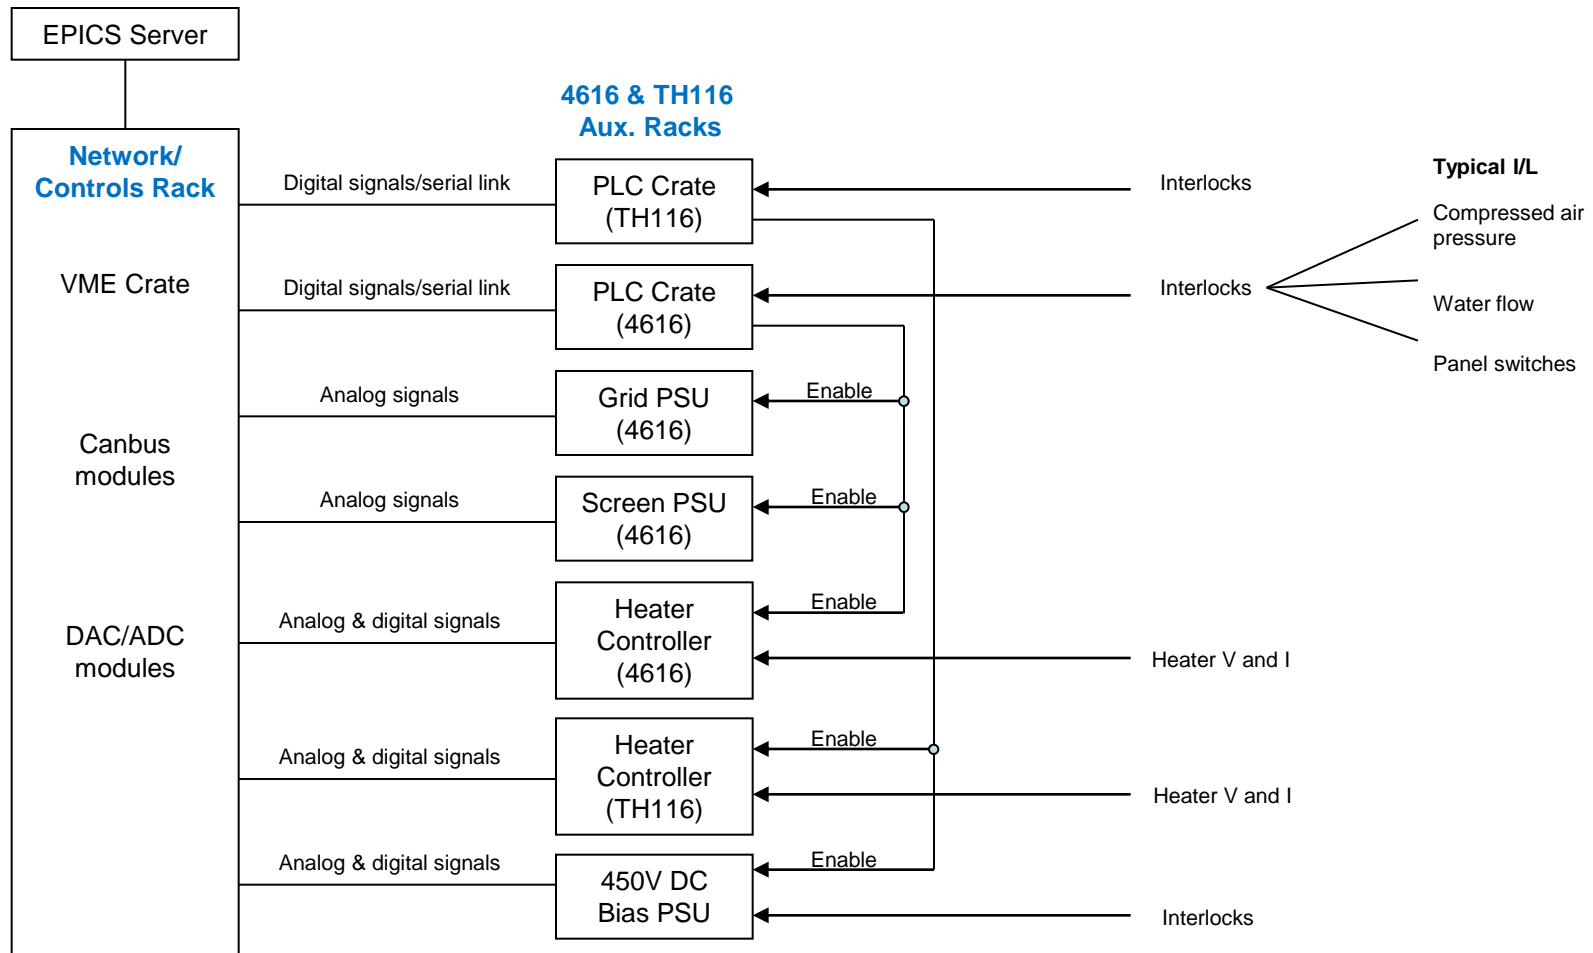



RF Power Supplies - MICE Hall Layout

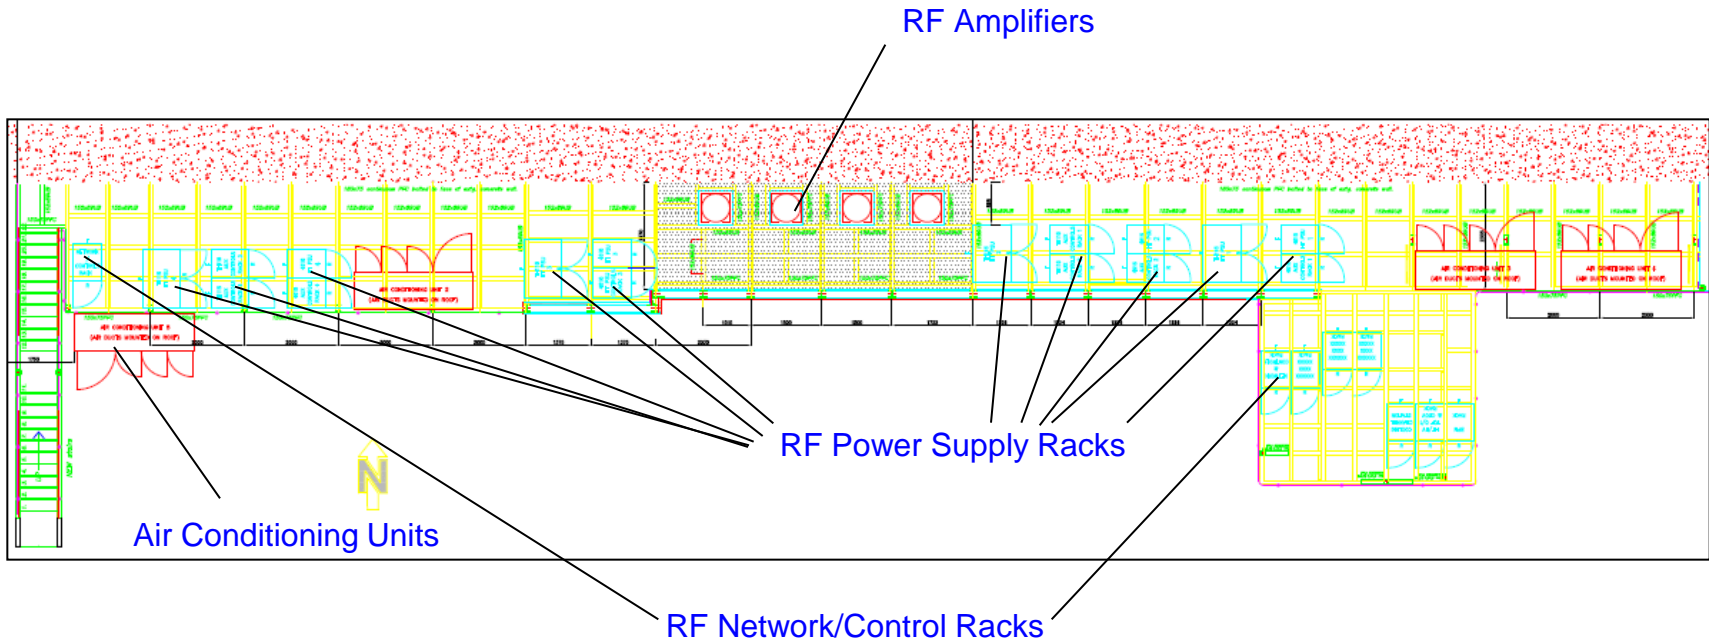

Layout of North Mezzanine



Timescale

Current work in progress:

- RF testing of System #1 with new 4616 and TH116 tubes Nov 11 to Mar 12

Future work (Step V): time-scales to be confirmed

- Assembly of CERN TH116 amplifier (System #2) ----- (July 2012)
- Test CERN amplifier at Daresbury ----- (December 2012)
- Develop RF Control Systems
- Pack & ship complete system #1 to RAL ----- (January 2013)
- Install RF System #1 in MICE Hall ----- (May 2013)
- Test complete RF system #1 at RAL ----- (September 2013)
- Construct & test 4616 #2 amplifier, power supply & controls
- Construct & test TH116 #2 power supply & controls
- Test complete RF system #2 at DL
- Pack & ship system #2 to RAL
- Install RF System #2 in MICE Hall
- Test complete RF system #2 at RAL

Tasks in red are required for TIARA (deadline in brackets)



Power Supplies – Construction Status - Step V


RF System #1 built and under test (manually controlled)

Work required:

- Control & monitoring upgrade for 4616 Screen Pulser (2 kV)
- Interface to MICE control system
 - Interface to PLC (Siemens S7-200)
 - Interface to Heater Controller (Eurotherm)
- Interface to Low Level RF and Timing System

RF System #2:

- 4616 amplifier circuit refurbishment has started
- 20 kV Power Supply rack to be built (some components available, some ordered)
- 4616 Auxiliary rack to be built (components to be ordered)
- CERN amplifier at DL – to be assembled when required
- Cathode modulator virtually complete
- 38 kV Power Supply rack to be built (components to be ordered)
- TH116 Auxiliary rack to be built (components to be ordered)
- Second dummy load to be procured for use with CERN amplifier (twin output)

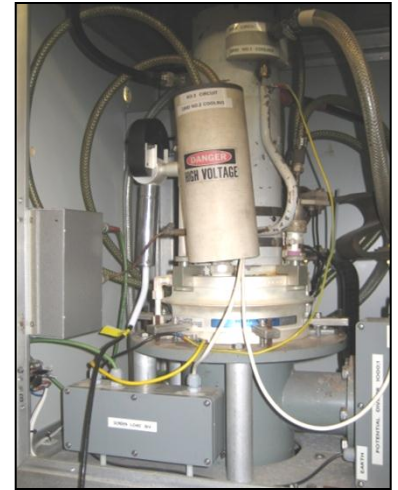

4616 Tube & Connections



Power Supplies – Construction Status - Step VI

RF Systems #3 and #4:

- TH116 amplifier circuit (ex-LBNL):
 - Mechanical refurbishment complete, tuning motors fitted
 - Electrical control panel to be built
- Second CERN amplifier at DL – to be assembled when required
- Cathode modulators to be built
- 4616 amplifier circuit (ex-LBNL) refurbishment has started
- Fourth 4616 amplifier circuit to be purchased
- 20 kV Power Supply racks to be built (some components available)
- 4616 Auxiliary racks to be built (components to be ordered)
- 38 kV Power Supply racks to be built (components to be ordered)
- TH116 Auxiliary racks to be built (components to be ordered)




20 kV PSU and Aux. Rack



RF Power Supplies

Questions ?

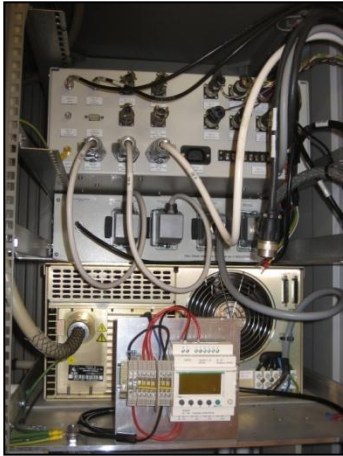

38 kV PSU – Charger (rear)



38 kV PSU Dump Relay & Voltage divider



38 kV PSU - rear view



20 kV PSU (front)