



Paths to CLIC power and energy efficiency

Philippe Lebrun

CLIC Workshop 2014
CERN, 3-7 February 2014



EnEfficient



Energy efficiency is the largest energy resource...


M. van der Hoeven, Energy efficiency market report 2013, IEA




In 2010 energy efficiency was the largest resource

■ Energy efficiency contributed 63 exajoules (EJ) (1400 Mtoe) of avoided energy use in 2010

● larger than the supply of oil (43 EJ), electricity or natural gas (22 EJ each)

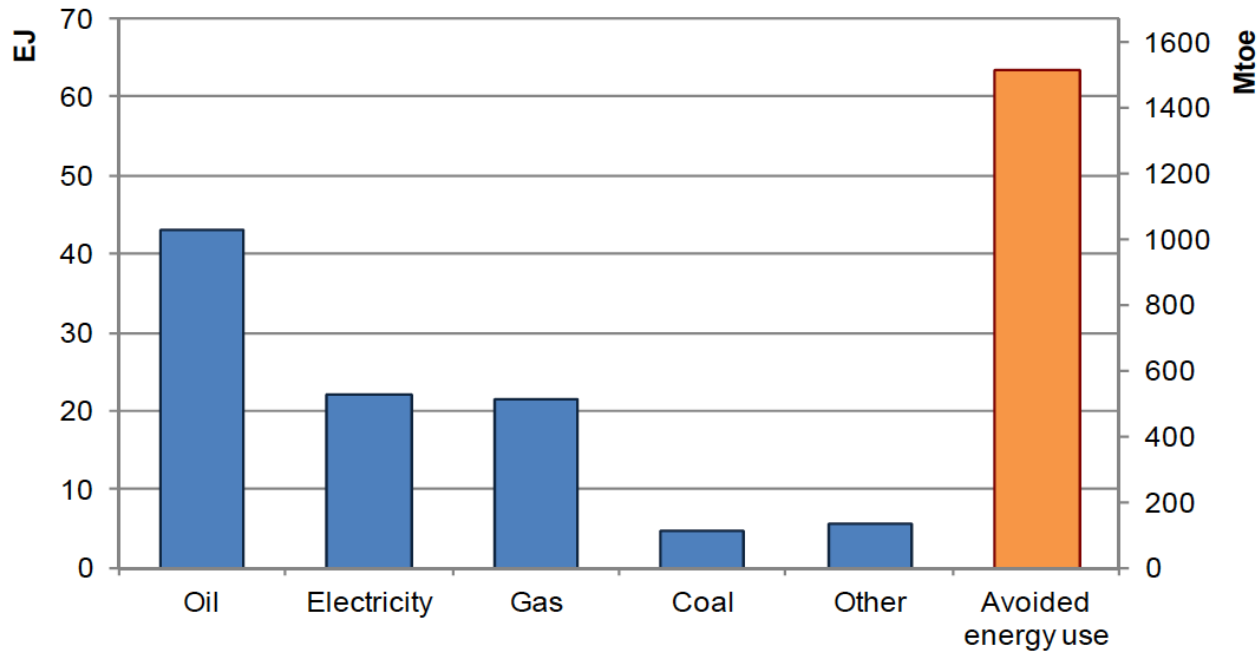

Contribution of energy efficiency compared to other energy resources consumed in 2010 in 11 IEA countries

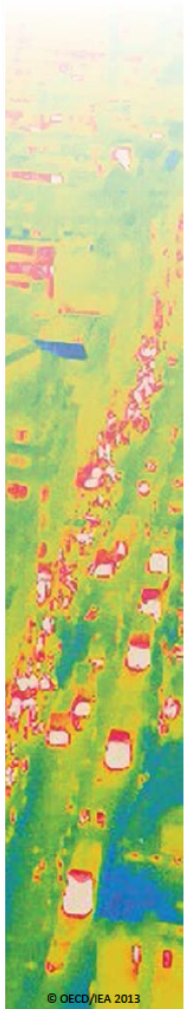


© OECD/IEA 2013



IEA's first fuel?

- Between 1974 and 2010, energy efficiency was the largest energy resource
- Cumulative avoided energy consumption due to energy efficiency in these IEA countries amounted to over 1 350 EJ (32 billion toe)

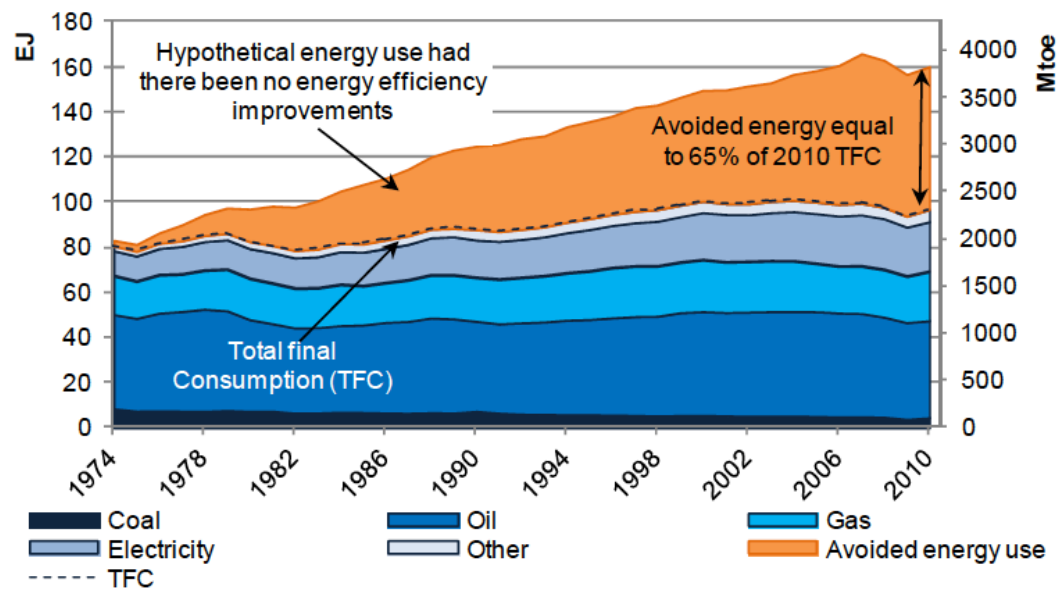

Long-term improvements in energy efficiency in 11 IEA countries



CLIC CDR parameters for Scenario A

« optimized for luminosity at 500 GeV »



Parameter	Symbol	Unit			
Centre-of-mass energy	\sqrt{s}	GeV	500	1400	3000
Repetition frequency	f_{rep}	Hz	50	50	50
Number of bunches per train	n_b		354	312	312
Bunch separation	Δ_t	ns	0.5	0.5	0.5
Accelerating gradient	G	MV/m	80	80/100	100
Total luminosity	\mathcal{L}	$10^{34} \text{ cm}^{-2} \text{ s}^{-1}$	2.3	3.2	5.9
Luminosity above 99% of \sqrt{s}	$\mathcal{L}_{0.01}$	$10^{34} \text{ cm}^{-2} \text{ s}^{-1}$	1.4	1.3	2
Main tunnel length		km	13.2	27.2	48.3
Charge per bunch	N	10^9	6.8	3.7	3.7
Bunch length	σ_z	μm	72	44	44
IP beam size	σ_x/σ_y	nm	200/2.6	$\approx 60/1.5$	$\approx 40/1$
Normalised emittance (end of linac)	$\varepsilon_x/\varepsilon_y$	nm	2350/20	660/20	660/20
Normalised emittance (IP)	$\varepsilon_x/\varepsilon_y$	nm	2400/25	—	—
Estimated power consumption	P_{wall}	MW	272	364	589



CLIC CDR parameters for Scenario B

« lower entry cost »



Parameter	Symbol	Unit			
Centre-of-mass energy	\sqrt{s}	GeV	500	1500	3000
Repetition frequency	f_{rep}	Hz	50	50	50
Number of bunches per train	n_b		312	312	312
Bunch separation	Δ_t	ns	0.5	0.5	0.5
Accelerating gradient	G	MV/m	100	100	100
Total luminosity	\mathcal{L}	$10^{34} \text{ cm}^{-2} \text{ s}^{-1}$	1.3	3.7	5.9
Luminosity above 99% of \sqrt{s}	$\mathcal{L}_{0.01}$	$10^{34} \text{ cm}^{-2} \text{ s}^{-1}$	0.7	1.4	2
Main tunnel length		km	11.4	27.2	48.3
Charge per bunch	N	10^9	3.7	3.7	3.7
Bunch length	σ_z	μm	44	44	44
IP beam size	σ_x/σ_y	nm	100/2.6	$\approx 60/1.5$	$\approx 40/1$
Normalised emittance (end of linac)	$\varepsilon_x/\varepsilon_y$	nm	—	660/20	660/20
Normalised emittance	$\varepsilon_x/\varepsilon_y$	nm	660/25	—	—
Estimated power consumption	P_{wall}	MW	235	364	589


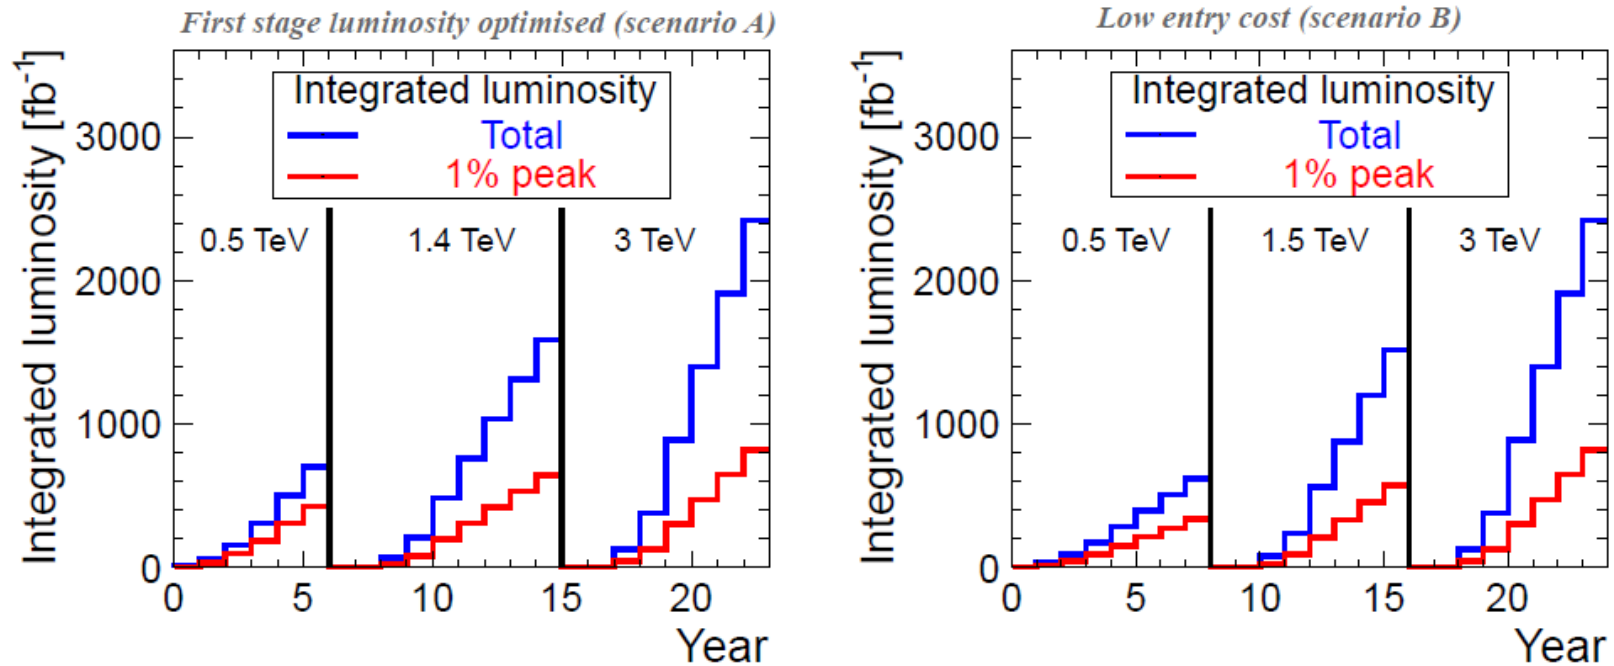


Fig. 5.2: Integrated luminosity in the scenarios optimised for luminosity in the first energy stage (left) and optimised for entry costs (right). Years are counted from the start of beam commissioning. These figures include luminosity ramp-up of four years (5%, 25%, 50%, 75%) in the first stage and two years (25%, 50%) in subsequent stages.

Power consumption of ancillary systems ventilated pro rata and included in numbers by WBS domain


500 GeV A
Total 272 MW

Drive Beam Main Beam up to 9 GeV Main Tunnel

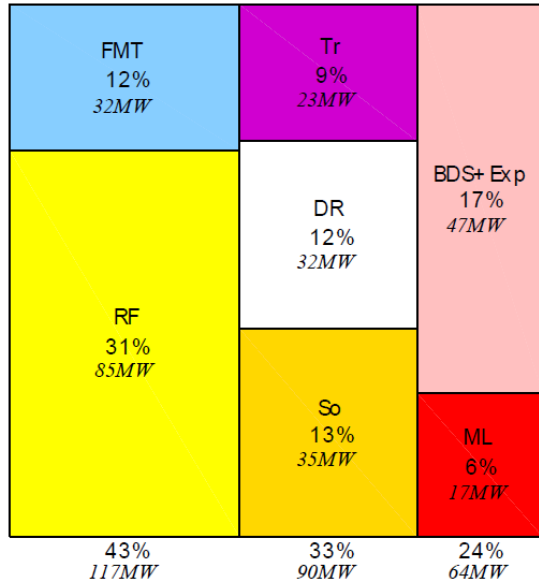


1.5 TeV
Total 364 MW

Drive Beam Main Beam up to 9 GeV Main Tunnel

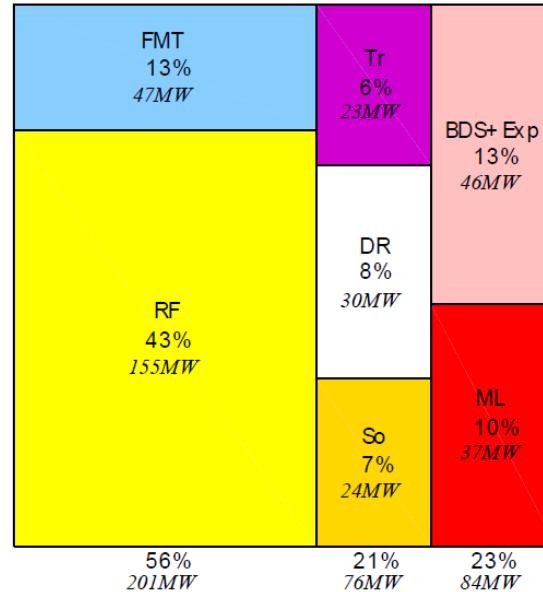

3 TeV
Total 589 MW

Drive Beam Main Beam up to 9 GeV Main Tunnel

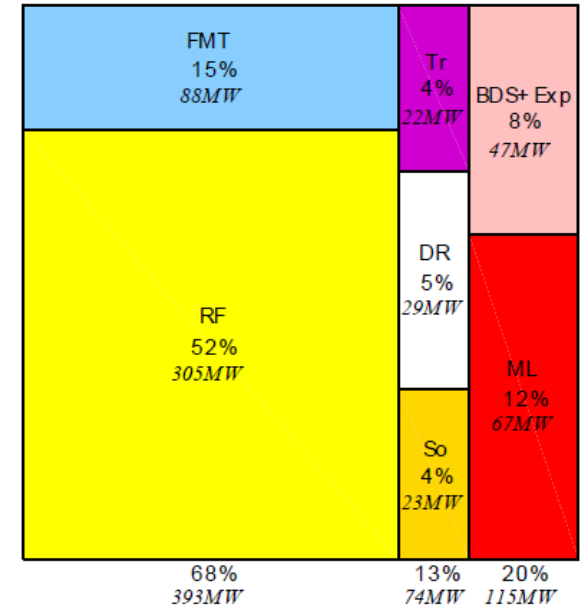


RF: drive beam linac, FMT: frequency multiplication & transport, So: sources & acceleration up to 2.5 GeV, DR: damping rings, Tr: booster linac up to 9 GeV & transport, ML: main linacs, BDS: beam delivery system, main dump & experimental area




CLIC CDR power consumption by technical system




500 GeV A Total 272 MW

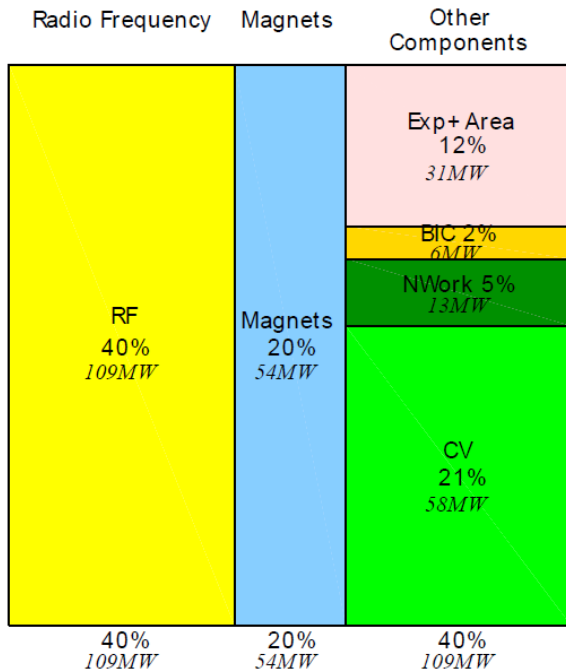

1.5 TeV Total 364 MW

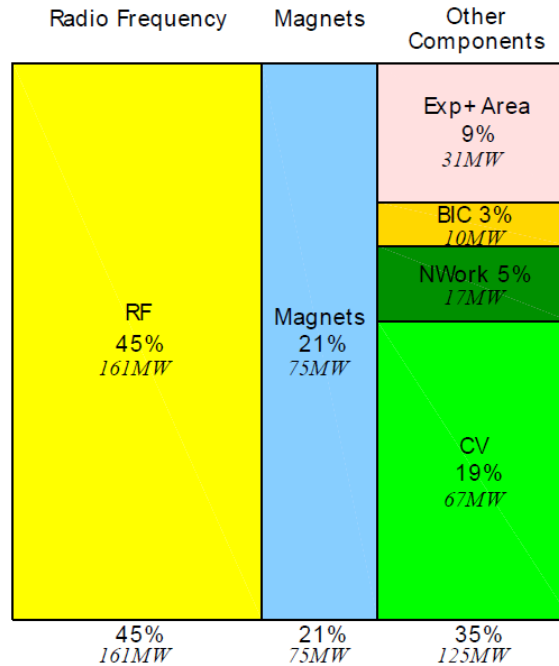

3 TeV Total 589 MW

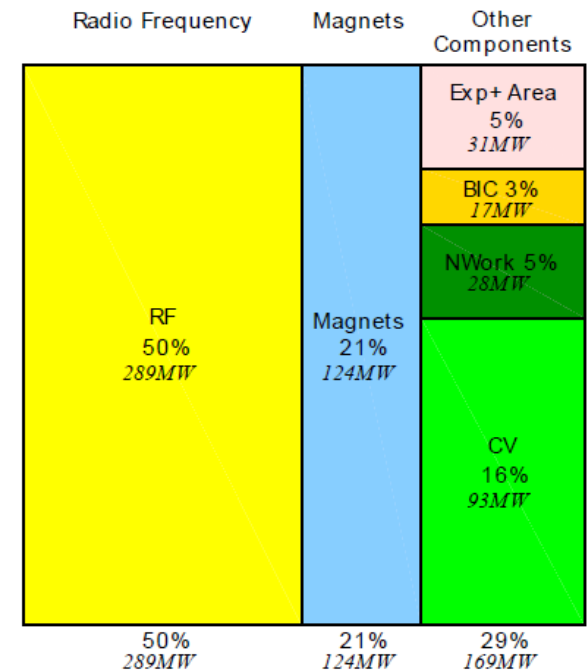

CV: cooling & ventilation, NW: electrical network losses, BIC: beam instrumentation & control





From power to energy

CLIC CDR assumptions



For each value of CM energy

- 177 days/year of beam time
- 188 days/year of scheduled and fault stops
- First year
 - 59 days of injector and one-by-one sector commissioning
 - 59 days of main linac commissioning, one linac at a time
 - 59 days of luminosity operation
 - All along : 50% of downtime
- Second year
 - 88 days with one linac at a time and 30 % of downtime
 - 88 days without downtime
- Third year
 - Still only one e+ target at 0.5 TeV, like for years 1 & 2
 - Nominal at 1.5 and 3 TeV
- Power during stops: scheduled (shutdown), unscheduled (fault), downtime

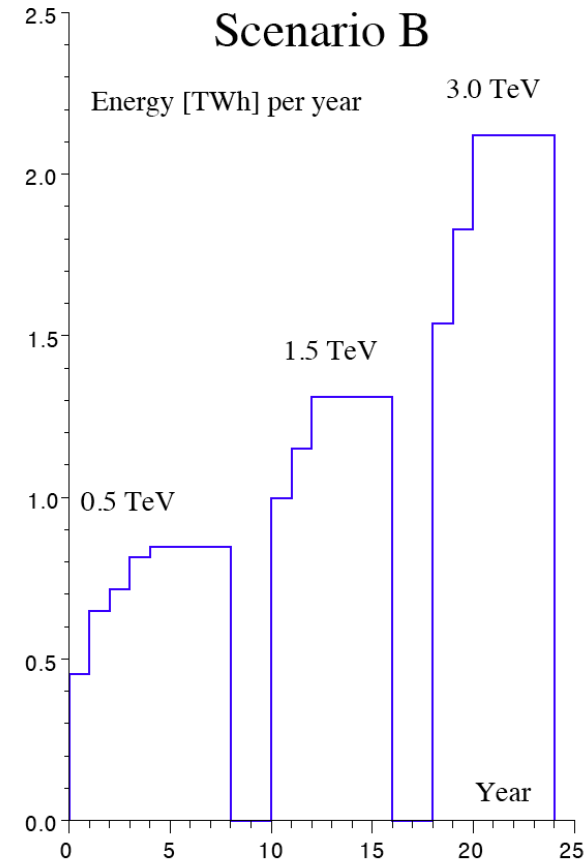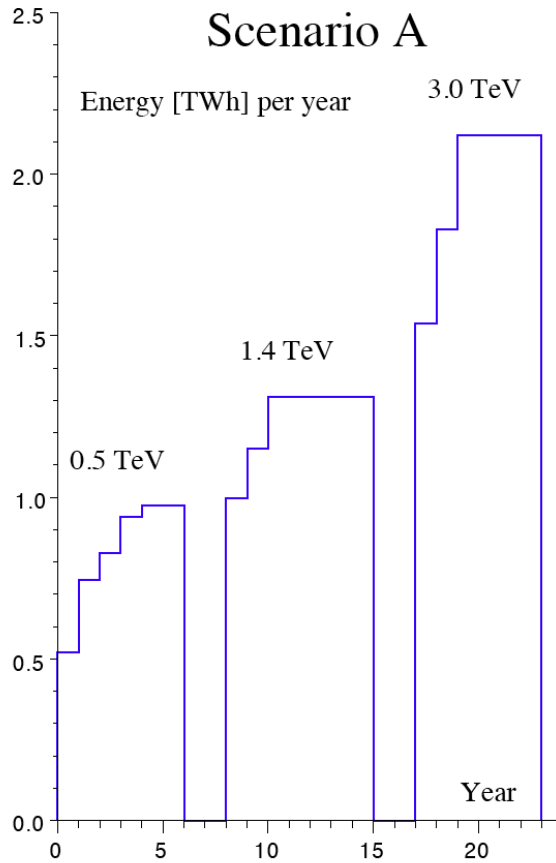

Integral over the whole programme

- Scenario A : 25.6 TWh
- Scenario B : 25.3 TWh



power & energy economy

sobriety

waste heat recovery

energy management

efficiency



Paths to power & energy savings

Sobriety




- Reduced current density in normal-conducting magnets
 - Magnets & overheads (electrical network losses, cooling & ventilation) represent 27 % of overall power at 3 TeV
 - For given magnet size and field, power scales with current density
 - Compromise between capital & real estate costs on one hand, and operation costs on the other hand
 - ⇒ *Talk by M. Modena, this session*
- Reduction of HVAC duty
 - Most heat loads already taken by water cooling
 - Possible further reduction in main tunnel by thermal shielding of cables
 - Possible reduction in surface buildings by improved thermal insulation, natural ventilation, relaxation of temperature limits
 - ⇒ *Talk by M. Nonis, this session*


- Grid-to-RF power conversion
 - R&D on klystrons
 - R&D on modulators, powering from the grid at HV
 - ⇒ Talks by D. Aguglia, A. Dal Gobbo, F. Cabaleiro Magallanes, M.S. Blume, M. Jankovic, this session
 - ⇒ Talks by S. Doebert, I. Syratchev, I. Guzilov, session «X-band & Power/Energy»
- RF-to-beam power conversion
 - Re-optimization of accelerating structures and gradient
 - ⇒ Talk by D. Schulte, plenary session «Accelerators», Friday 7 February
- Permanent or super-ferric superconducting magnets
 - Permanent magnets
 - distributed uses, e.g. main linacs
 - fixed-field/wind-up magnets
 - ⇒ Talk by B. Stenlund, session «Permanent magnets»
 - Super-ferric superconducting magnets
 - «grouped» and DC uses, e.g. combiner rings, DB return loops in main linacs

Total potential for power savings at 3 TeV
- magnets ~ 86 MW
- cooling & ventilation ~ 24 MW

$$\rho_{\text{power}} = P_{\text{out}}/P_{\text{in}}$$

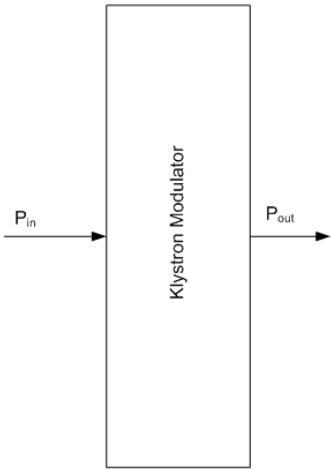


$$\rho_{\text{pulse}} = E_{\text{ideal_pulse}}/E_{\text{real_pulse}}$$

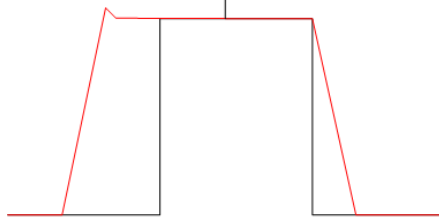

$$\rho_{\text{modulator}} = \rho_{\text{power}} * \rho_{\text{pulse}}$$

Useful flat-top Energy	22MW*140μs = 3.08kJ
Rise/fall time energy	22MW*5μs*2/3= 0.07kJ
Set-up time energy	22MW*5μs = 0.09kJ
Pulse efficiency	0.95
Pulse forming system efficiency	0.98
Charger efficiency	0.96
Power efficiency	0.94
Overall Modulator efficiency	89%


400/36kV



??kV


Modulator

150kV

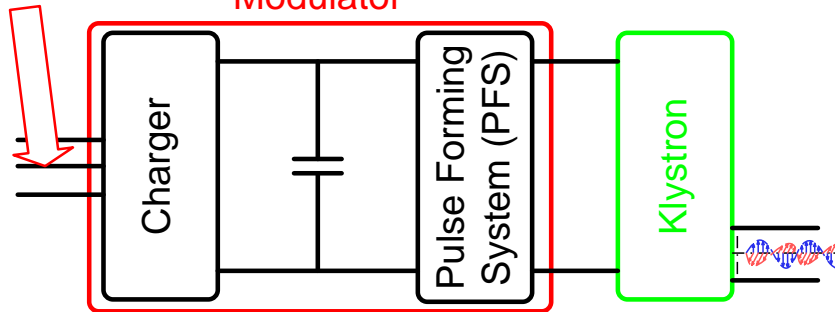


D. Nisbet & D. Aguglia

Conventional electromagnet

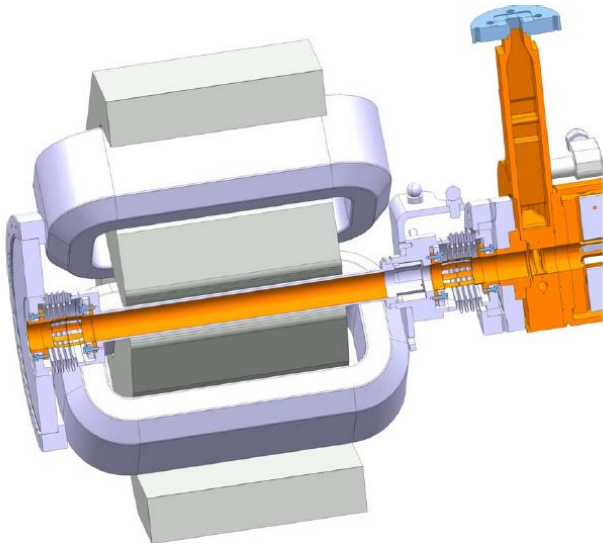

Tunable permanent magnet

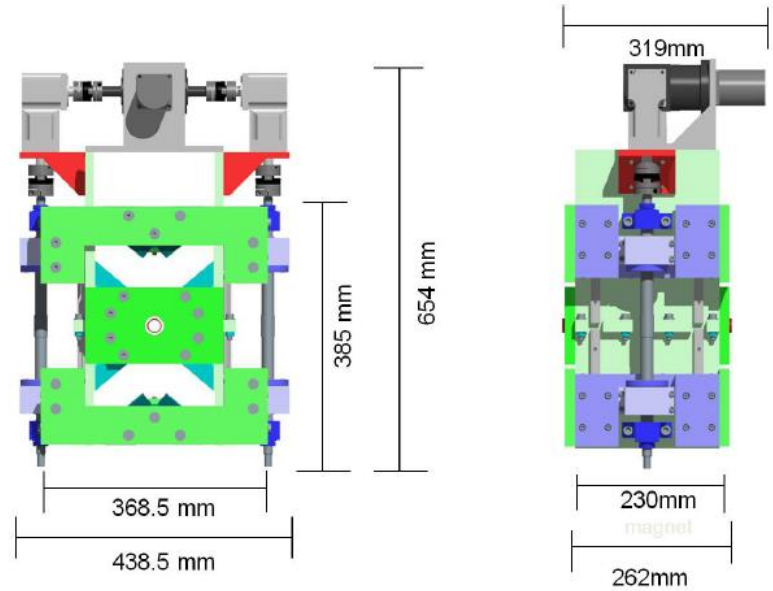

M. Modena, B. Shepherd

- Low-power configurations in case of beam interruption

Staging Scenario	E_{CM} [TeV]	$P_{nominal}$ [MW]	$P_{waiting\ for\ beam}$ [MW]	$P_{shutdown}$ [MW]
A	0.5	272	168	37
	1.4	364	190	42
	3.0	589	268	58
B	0.5	235	167	35
	1.5	364	190	42
	3.0	589	268	58

- Modulation of scheduled operation to match electricity demand
 - Seasonal load shedding
 - Diurnal peak shaving

⇒ *Talks by A. Latina & F. Duval, this session*




Variations of electricity demand in France (source: RTE)



Exemple de cycle annuel


(dans des conditions de température de référence)

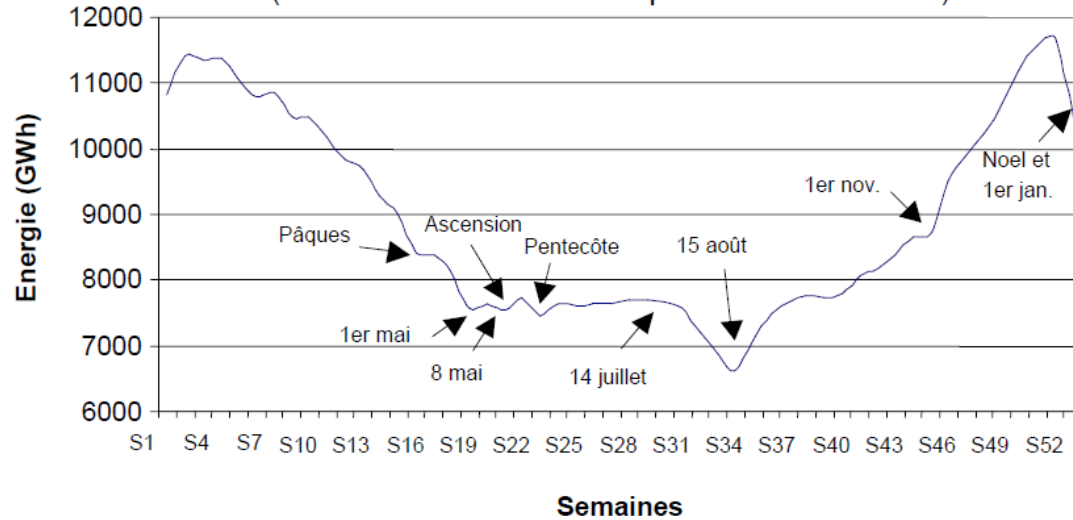

Annual variations of power consumption (integrated weekly)


Diurnal variations of power consumption (winter day)

Exemple de cycle journalier en hiver

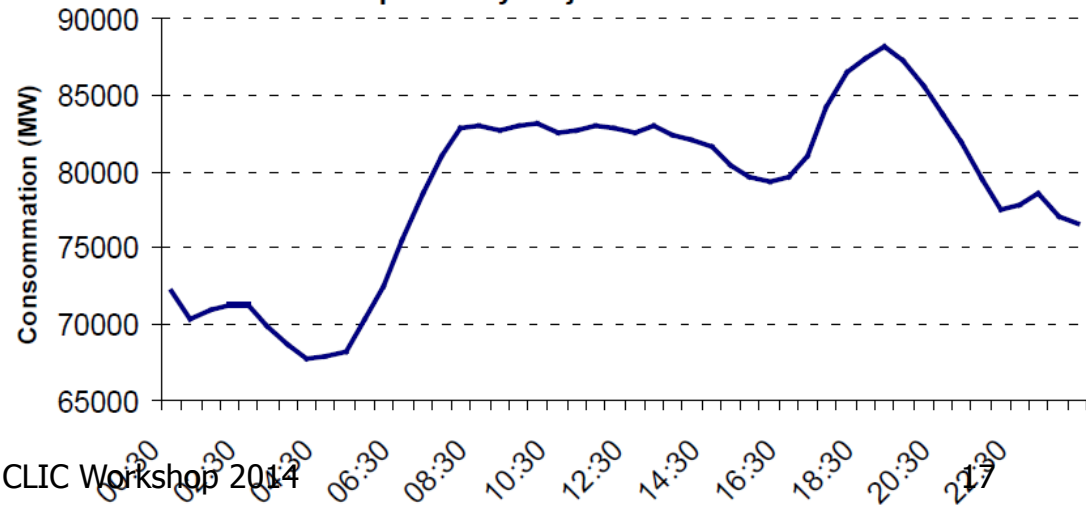


- Possibilities of heat rejection at higher temperature, e.g. beam dumps
- Valorization of low-grade waste heat for concomitant needs, e.g. residential heating or absorption cooling

Three-bed, two evaporator adsorption chiller
(Wroclaw Technology Park)

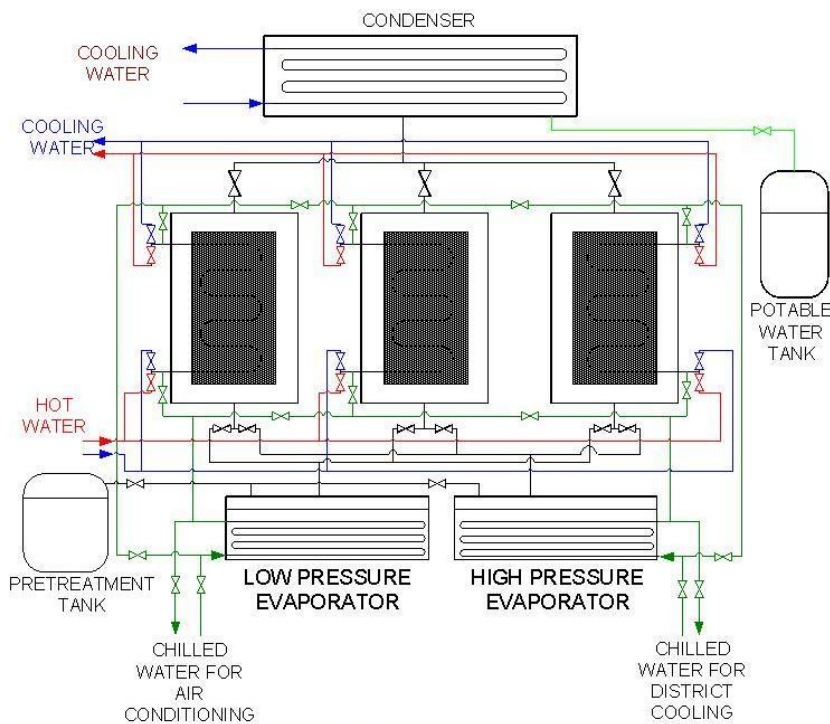

$T_{\text{hot water}}$	60°C
$T_{\text{cooling water}}$	25°C
$T_{\text{chilled water LP}}$	9°C
$T_{\text{chilled water HP}}$	15°C
Capacity	12.5 Rton ~ 45 kW
Mode	3-bed, 2-evaporator

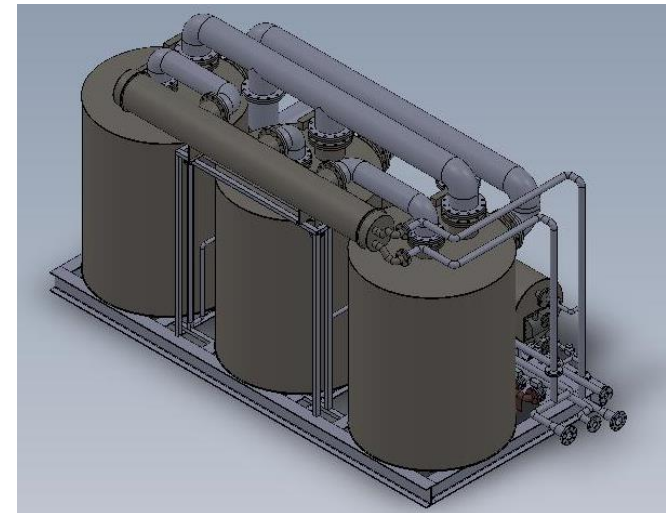

- Consider heat rejection Q at temperature T with environment at T_0
- What are the recovery options?
 - 1) use as such
 - Is there a concomitant need for heat Q at $T=T_{\text{use}}$?
 - 2) use as heat at higher temperature $T_{\text{use}} > T$
 - Minimum work required for heat pump $W_{\text{min}} = Q (T_{\text{use}}/T - 1)$
 - Example: for raising waste heat from 40 °C to 80 °C, $W_{\text{min}} = 0.13 Q$
 - In practice, W_{real} may be 2 to 3 times higher
 - May still be an interesting option
 - 3) use to produce work
 - Maximum work produced (Carnot machine) $W_{\text{max}} = Q (1 - T_0/T)$
 - This can also be written $W_{\text{max}} = Q - T_0 \Delta S = \text{Exergy}$
 - Example: with $T = 40$ °C and $T_0 = 15$ °C, $W_{\text{max}} = 0.08 Q$
 - In practice, W_{real} is only a fraction of this
 - Very inefficient unless one operates at higher T

⇒ Investigate all options, using both energy and exergy as f.o.m.

Tenvironment = Tair = 15 C = 288 K						
Twater = 40 C = 313 K						
Assume 0.9 of magnet energy in water, 0.1 in air						
	Electrical efficiency	Electrical energy	Heat rejected in water	Heat rejected in air	Electrical exergy	Exergy in water
Network	NA	100.0			100.0	
AC distribution	0.97	97.0		3.0	97.0	
Power converter	0.9	87.3	9.7		87.3	0.8
DC cables	0.95	82.9		4.4	82.9	
Magnet	0	0.0	74.6	8.3	0.0	6.0
Environment	NA		84.3	15.7		6.7

- 100 drawn from network produces only 82.9 used in magnet
- Waste heat in water contains 84.3% of consumed energy, but only 6.7% of consumed exergy: waste heat recovery is therefore interesting for final use as heat, not as source of electrical/mechanical energy
- Exergy economy should target improvement of electrical efficiency upstream the magnets, rather than waste heat recovery

Tenvironment = Tair = 15 C = 288 K						
Twater = 60 C = 333 K						
Assume 0.9 of magnet energy in water, 0.1 in air						
	Electrical efficiency	Electrical energy	Heat rejected in water	Heat rejected in air	Electrical exergy	Exergy in water
Network	NA	100.0			100.0	
AC distribution	0.97	97.0		3.0	97.0	
Power converter	0.9	87.3	9.7		87.3	1.3
DC cables	0.95	82.9		4.4	82.9	
Magnet	0	0.0	74.6	8.3	0.0	10.1
Environment	NA		84.3	15.7		11.4

- Increasing cooling water temperature to 60 °C raises its exergy content to 11.4%

Tenvironment = Tair = 15 C = 288 K								
Twater1 = 40 C = 313 K								
Twater2 = 40 C = 313 K								
Assume 0.25 of AS energy in beam, 0.65 in water, 0.1 in air								
	Electrical efficiency	Electrical energy	Heat rejected in water1	Heat rejected in water2	Heat rejected in air	Electrical exergy	Exergy in water1	Exergy in water2
Network	NA	100.0				100.0		
AC distribution	0.97	97.0			3.0	97.0		
Modulator	0.89	86.3	10.7			86.3	0.9	
Klystron	0.7	60.4		25.9		60.4		2.1
RF distr & DB cavity	0.89	53.8	6.6			53.8	0.5	
PETS	0.98	52.7	1.1			52.7	0.1	
DB deceleration	0.83	43.7		9.0		43.7		0.7
AS	0.25	10.9	28.4		4.4	10.9	2.3	
MB dump	0	0.0		10.9		0.0		0.9
Environment	NA		46.8	45.8	7.4		3.7	3.7

- 100 drawn from network produces only 53.8 in PETS, 43.7 in AS, of which 10.9 goes into the main beam
- Waste heat in water contains 92.6% of consumed energy, but only 7.4% of consumed exergy: waste heat should rather be valorized as heat
- Exergy economy should target improvement of electrical efficiency upstream the magnets, rather than waste heat recovery



Energy dissipation & exergy in CLIC RF systems

T cooling water = 40 °C & 80 °C (klystrons & beam dumps)



Tenvironment = Tair = 15 C = 288 K								
Twater1 = 40 C = 313 K								
Twater2 = 80 C = 353 K								
Assume 0.25 of AS energy in beam, 0.65 in water, 0.1 in air								
	Electrical efficiency	Electrical energy	Heat rejected in water1	Heat rejected in water2	Heat rejected in air	Electrical exergy	Exergy in water1	Exergy in water2
Network	NA	100.0				100.0		
AC distribution	0.97	97.0			3.0	97.0		
Modulator	0.89	86.3	10.7			86.3	0.9	
Klystron	0.7	60.4		25.9		60.4		4.8
RF distr & DB cavity	0.89	53.8	6.6			53.8	0.5	
PETS	0.98	52.7	1.1			52.7	0.1	
DB deceleration	0.83	43.7		9.0		43.7		1.6
AS	0.25	10.9	28.4		4.4	10.9	2.3	
MB dump	0	0.0		10.9		0.0		2.0
Environment	NA		46.8	45.8	7.4		3.7	8.4

- Increasing klystron and beam dump cooling water temperature to 80 °C raises its exergy content to 8.4%, i.e. 12.1% in total (water1 and water2)



Conclusions



- Power consumption of CLIC and other large accelerator projects at the energy frontier has become a major issue in their technical feasibility, economic affordability and social acceptance
- Power and energy savings are therefore essential aspects of the study of such machines from the conceptual design phase
- Paths towards this goal include sobriety, efficiency, energy management and waste heat recovery and valorisation
- This is acknowledged, *inter alia*, in the EnEfficient Work Package of the EuCARD2 Integrating Activity in the EU Seventh Framework Programme
- The following presentations in this session of the CLIC Workshop 2014 address most of these lines of action



www.cern.ch