


Closing water cooled cables holes between LHC tunnel and USC55 CV room

AGI will close holes on the gallery side

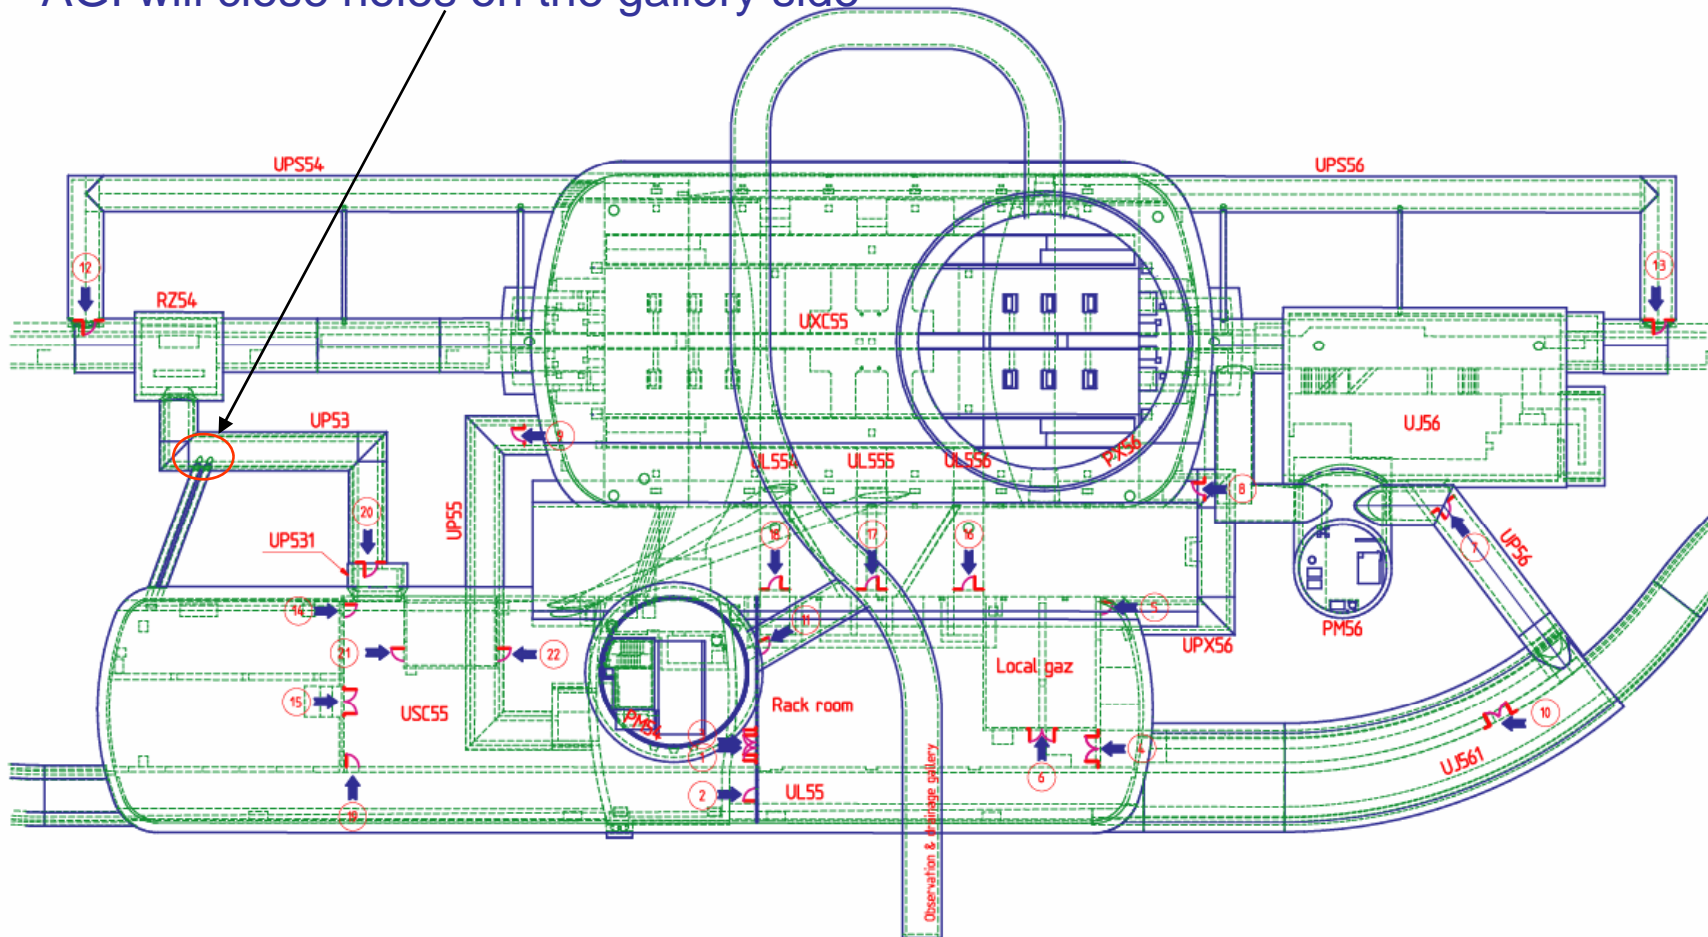

TS-EL to check that no Cu cable is missing in gallery
Insulation should be applied between the cable duct and seal