

# PS Status 7 - 14 September


K Hanke

Users' Meeting 14 September 2017

- very good availability until yesterday
- minor issues with wire scanners and electrical glitches
- This night PFW power supply trips, AD user stopped, expert working

availability **98.2 %** until this night  
**90.2 %** this morning (AD concerned)

Root Cause Fault Time Distribution

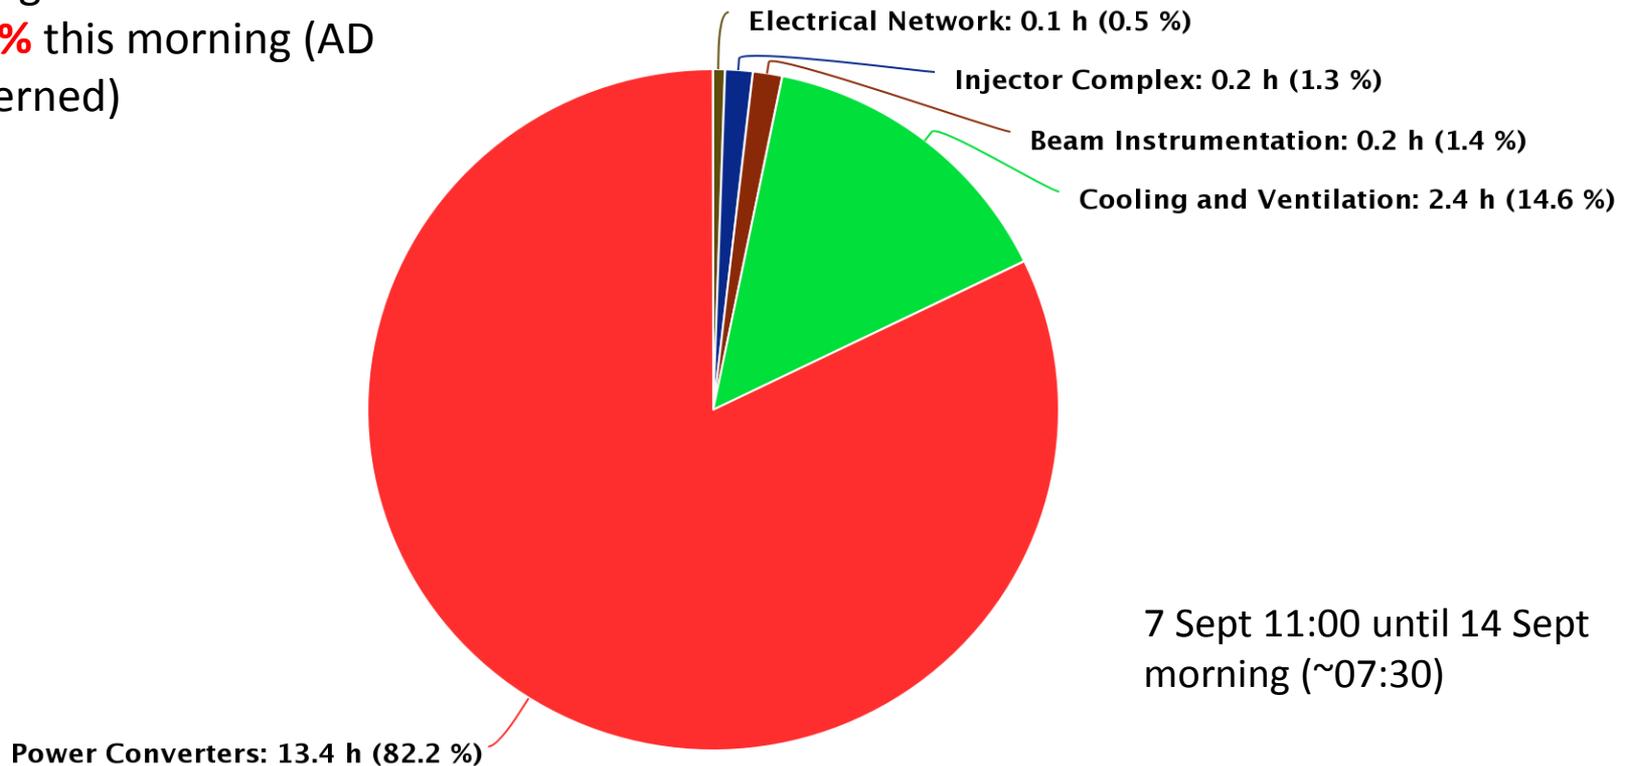

● Electrical Network ● Injector Complex ● Beam Instrumentation ● Cooling and Ventilation ● Power Converters

- Since Wednesday 13 September we give back nominal number of pulses to TOF
- Beam position in TT2 logged in Timber, application with essential data has been set up
- Technical stop upcoming

